

GEOTECHNICAL INVESTIGATION

PROPOSED MIXED-USE DEVELOPMENT MAIN STREET & 9TH STREET SANTA CLARITA, CALIFORNIA



GEOCON
WEST, INC.

GEOTECHNICAL
ENVIRONMENTAL
MATERIALS

PREPARED FOR

**OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
GLENDALE, CALIFORNIA**

PROJECT NO. A9332-06-01

REVISED NOVEMBER 10, 2015



Project No. A9332-06-01
October 30, 2015
Revised November 10, 2015

Old Town-Main, LLC
c/o Serrano Development Group, Inc.
Attn: Mr. Jason Tolleson
500 North Brand Boulevard, Suite #2120
Glendale, California 91203

Subject: GEOTECHNICAL INVESTIGATION
 PROPOSED MIXED-USE DEVELOPMENT
 MAIN STREET AND 9th STREET
 SANTA CLARITA, CALIFORNIA

Dear Mr. Tolleson:

In accordance with your authorization of our proposal dated July 21, 2015 (Revised August 20, 2015), we have performed a geotechnical investigation for the proposed mixed-use development located at Main Street and 9th Street in the City of Santa Clarita, California. The accompanying report presents the findings of our study, and our conclusions and recommendations pertaining to the geotechnical aspects of proposed design and construction. Based on the results of our investigation, it is our opinion that the site can be developed as proposed, provided the recommendations of this report are followed and implemented during design and construction.

If you have any questions regarding this report, or if we may be of further service, please contact the undersigned.

Very truly yours,

GEOCON WEST, INC.

Petrina Zen
Petrina Zen
Staff Engineer



Jelisa Thomas
PE 74946



Susan F. Kirkgard
CEG 1754

(EMAIL) Addressee

TABLE OF CONTENTS

1.	PURPOSE AND SCOPE	1
2.	SITE AND PROJECT DESCRIPTION	1
3.	GEOLOGIC SETTING	2
4.	SOIL AND GEOLOGIC CONDITIONS	3
4.1	Artificial Fill	3
4.2	Alluvium	3
5.	GROUNDWATER	3
6.	GEOLOGIC HAZARDS	4
6.1	Surface Fault Rupture	4
6.2	Seismicity	5
6.3	Seismic Design Criteria	6
6.4	Liquefaction Potential	7
6.5	Slope Stability	8
6.6	Earthquake-Induced Flooding	8
6.7	Tsunamis, Seiches, and Flooding	8
6.8	Oil Fields & Methane Potential	9
6.9	Subsidence	9
7.	CONCLUSIONS AND RECOMMENDATIONS	10
7.1	General	10
7.2	Soil and Excavation Characteristics	13
7.3	Minimum Resistivity, pH, and Water-Soluble Sulfate	13
7.4	Grading	14
7.5	Shrinkage	16
7.6	Foundation Design	17
7.7	Deepened Foundations – End Bearing Piles	18
7.8	Foundation Settlement	20
7.9	Miscellaneous Foundations	20
7.10	Lateral Design	21
7.11	Concrete Slabs-on-Grade	21
7.12	Preliminary Pavement Recommendations	23
7.13	Retaining Wall Design	24
7.14	Dynamic (Seismic) Lateral Forces	26
7.15	Retaining Wall Drainage	27
7.16	Elevator Pit Design	27
7.17	Elevator Piston	28
7.18	Temporary Excavations	28
7.19	Slot Cutting	29
7.20	Shoring – Soldier Pile Design and Installation & Underpinning	31
7.21	Tie-Back Anchors	38
7.22	Anchor Installation	38
7.23	Anchor Testing	39
7.24	Internal Bracing	39
7.25	Stormwater Infiltration	40
7.26	Surface Drainage	41
7.27	Plan Review	42

LIMITATIONS AND UNIFORMITY OF CONDITIONS

LIST OF REFERENCES

TABLE OF CONTENTS (Continued)

MAPS, TABLES, AND ILLUSTRATIONS

- Figure 1, Vicinity Map
- Figure 2, Site Plan
- Figure 3, Regional Fault Map
- Figure 4, Regional Seismicity Map
- Figures 5 and 6, Retaining Wall Drainage

APPENDIX A

FIELD INVESTIGATION

- Figures A1 through A7, Boring Logs

APPENDIX B

LABORATORY TESTING

- Figures B1 through B4, Direct Shear Test Results
- Figures B5 through B8, Consolidation Test Results
- Figure B9, Lab Test Results
- Figure B10, Corrosivity Test Results

GEOTECHNICAL INVESTIGATION

1. PURPOSE AND SCOPE

This report presents the results of a geotechnical investigation for the proposed mixed-use development located at Main Street and 9th Street in the City of Santa Clarita, California (see Vicinity Map, Figure 1). The purpose of the investigation was to evaluate subsurface soil and geologic conditions underlying the site and, based on conditions encountered, to provide conclusions and recommendations pertaining to the geotechnical aspects of design and construction.

The scope of this investigation included a site reconnaissance, field exploration, laboratory testing, engineering analysis, and the preparation of this report. The site was explored on October 5, 2015, by excavating seven 8-inch diameter borings utilizing a truck-mounted hollow-stem auger drilling machine. The borings were advanced to depths of 20½ and 30½ feet below the existing ground surface. The approximate locations of the exploratory borings are depicted on the Site Plan (see Figure 2). A detailed discussion of the field investigation, including boring logs, is presented in Appendix A.

Laboratory tests were performed on selected soil samples obtained during the investigation to determine pertinent physical and chemical soil properties. Appendix B presents a summary of the laboratory test results.

The recommendations presented herein are based on analysis of the data obtained during the investigation and our experience with similar soil and geologic conditions. References reviewed to prepare this report are provided in the *List of References* section.

If project details vary significantly from those described herein, Geocon should be contacted to determine the necessity for review and possible revision of this report.

2. SITE AND PROJECT DESCRIPTION

The subject site is located at Main Street and 9th Street in the City of Santa Clarita, California. The site is a rectangular-shaped parcel and is currently a vacant lot. The site is bounded by Lyons Avenue to the northwest, by Railroad Avenue to the northeast, by 9th Street to the southeast, and by Main Street to the southwest. The site is relatively level, with no pronounced highs or lows. Surface water drainage at the site appears to be by sheet flow along the existing ground contours to the city streets. Vegetation onsite consists of plants and trees, which are located in isolated planter areas.

Based on the information provided by the Client, it is our understanding that the proposed development will consist of three- to four-stories of multi-family residential housing over one level of retail to be constructed over one level of subterranean parking. The development will also include a two-story theater to be constructed at or near present site grade, and a five-story parking structure constructed over one subterranean level.

Based on the preliminary nature of the design at this time, wall and column loads were not available. It is anticipated that column loads for the proposed mixed-use structure will be up to 500 kips, and wall loads will be up to 6 kips per linear foot. It is anticipated that column loads for the proposed theater will be up to 300 kips, and wall loads will be up to 4 kips per linear foot. It is anticipated that column loads for the proposed parking structure will be up to 600 kips, and wall loads will be up to 8 kips per linear foot.

Once the design phase and foundation loading configuration proceeds to a more finalized plan, the recommendations within this report should be reviewed and revised, if necessary. Any changes in the design, location or elevation of any structure, as outlined in this report, should be reviewed by this office. Geocon should be contacted to determine the necessity for review and possible revision of this report.

3. GEOLOGIC SETTING

The site is located within the Santa Clara River Valley of the Ridge Basin area of the western San Gabriel Mountains. The site is underlain by a deep accumulation of alluvial sediments derived from the Santa Clara River and its tributaries. The Ridge Basin, is an elongated, narrow (roughly 25 miles long by 10 miles wide) northwest-southeast trending structural trough that lies within the Transverse Ranges geomorphic province between the San Gabriel and San Andreas fault zones. Rock units within this trough consist of an estimated 40,000 feet of late Miocene to early Pleistocene age marine and continental derived sedimentary bedrock units. These upper deposits include the Plio-Pleistocene age Saugus Formation.

Regionally, the site is located in the Transverse Ranges geomorphic province. The province is bounded by the Big Pine Fault on the north, the San Andreas Fault Zone on the east, the Pacific Ocean on the west, and the Santa Monica, Raymond, Sierra Madre, and Cucamonga faults on the south. The province is characterized by east-west trending mountain ranges that include the Santa Ynez, San Gabriel, San Bernardino, and Santa Monica Mountains.

4. SOIL AND GEOLOGIC CONDITIONS

Based on our field investigation and published geologic maps of the area, the site is underlain by artificial fill and Holocene age alluvium consisting of varying amounts of unconsolidated sand, silt, and gravel originating from nearby Newhall Creek and other local drainages (Treiman, 1986; Dibblee 1996). Detailed stratigraphic profiles are provided on the boring logs in Appendix A.

4.1 Artificial Fill

Artificial fill was encountered in our field explorations to a maximum depth of 5 feet below existing ground surface. The artificial fill generally consists of brown silty sand and sand with silt. The artificial fill is characterized as slightly moist and loose to medium dense. The fill is likely the result of past grading or construction activities at the site. Deeper fill may exist between excavations and in other portions of the site that were not directly explored.

4.2 Alluvium

Holocene age alluvium was encountered beneath the fill and consists primarily of brown to light brown silty sand, and sand with silt with varying amounts of fine to coarse gravel. The alluvial soils are primarily slightly moist and loose to medium dense.

5. GROUNDWATER

Based on a review of the Seismic Hazard Zone Report for the Newhall 7.5 Minute Quadrangle, Los Angeles County, California (California Division of Mines and Geology [CDMG], 1997), the historically highest groundwater level in the area is greater than approximately 55 feet beneath the ground surface. Groundwater information presented in this document is generated from data collected in the early 1900's to the late 1990s.

The Los Angeles County Department of Public Works (LACDPW) has maintained various wells in the vicinity of the subject site over the past 55 years. The closest groundwater monitoring well to the site is Well No. 5861E (State Well No. 4N16W35L01) located near the intersection of 13th Street and Railroad Avenue, approximately 0.3 mile to the north, (LACDPW, 2015a). Review of the available monitoring data for this well for the monitoring period between 1959 and 2013 indicate that the depth to groundwater has fluctuated between high and low measurements of 33 feet below the existing ground surface in October, 2005 to 212 feet below the existing ground surface in October, 1991, respectively (LACDPW, 2015a). The most recent groundwater level measurement for Well No. 5861E was measured on October 1, 2013 at a depth of 54 feet below the existing ground surface (LACDPW, 2015a).

Groundwater was not encountered in our field explorations, drilled to a maximum depth of 30½ feet below the existing ground surface. Based on the historic high groundwater levels in the site vicinity, the lack of groundwater in our borings, and the depth of proposed construction, groundwater is neither expected to be encountered during construction, nor have a detrimental effect on the project. However, it is not uncommon for groundwater levels to vary seasonally or for groundwater seepage conditions to develop where none previously existed, especially in impermeable fine-grained soils which are heavily irrigated or after seasonal rainfall. In addition, recent requirements for stormwater infiltration could result in shallower seepage conditions in the immediate site vicinity. Proper surface drainage of irrigation and precipitation will be critical for future performance of the project. Recommendations for drainage are provided in the *Surface Drainage* section of this report (see Section 7.26).

6. GEOLOGIC HAZARDS

6.1 Surface Fault Rupture

The numerous faults in Southern California include active, potentially active, and inactive faults. The criteria for these major groups are based on criteria developed by the California Geological Survey (CGS, formerly known as CDMG) for the Alquist-Priolo Earthquake Fault Zone Program (Bryant and Hart, 2007). By definition, an active fault is one that has had surface displacement within Holocene time (about the last 11,000 years). A potentially active fault has demonstrated surface displacement during Quaternary time (approximately the last 1.6 million years), but has had no known Holocene movement. Faults that have not moved in the last 1.6 million years are considered inactive.

The site is not within a currently established Alquist-Priolo Earthquake Fault Zone for surface fault rupture hazards. No active or potentially active faults with the potential for surface fault rupture are known to pass directly beneath the site. Therefore, the potential for surface rupture due to faulting occurring beneath the site during the design life of the proposed development is considered low. However, the site is located in the seismically active Southern California region, and could be subjected to moderate to strong ground shaking in the event of an earthquake on one of the many active Southern California faults. The faults in the vicinity of the site are shown in Figure 3, Regional Fault Map.

The closest surface trace of an active fault to the site is the San Gabriel Fault Zone located approximately 1.6 miles north-northeast of the site (Ziony and Jones, 1989; Dibblee, 1996). Other nearby active faults are the Santa Susana Fault, the Northridge Fault, the Simi-Santa Rosa Fault Zone, and the San Fernando Fault located 4.9 miles south, 7.9 miles south-southeast, 9.2 miles northwest, and 12.5 miles southeast of the site, respectively (Ziony and Jones, 1989). The active San Andreas Fault Zone is located approximately 20 miles northeast of the site.

The closest potentially active faults to the site is the Holser Fault and the Del Valle Fault located approximately 4.4 miles north-northeast and 8.1 miles north-northwest of the site, respectively (Ziony and Jones, 1989).

Several buried thrust faults, commonly referred to as blind thrusts, underlie the Los Angeles Basin at depth. These faults are not exposed at the ground surface and are typically identified at depths greater than 3.0 kilometers. The October 1, 1987 M_w 5.9 Whittier Narrows earthquake and the January 17, 1994 M_w 6.7 Northridge earthquake were a result of movement on the Puente Hills Blind Thrust and the Northridge Thrust, respectively. These thrust faults and others in the Los Angeles area are not exposed at the surface and do not present a potential surface fault rupture hazard at the site; however, these deep thrust faults are considered active features capable of generating future earthquakes that could result in moderate to significant ground shaking at the site.

6.2 Seismicity

As with all of Southern California, the site has experienced historic earthquakes from various regional faults. The seismicity of the region surrounding the site was formulated based on research of an electronic database of earthquake data. The epicenters of recorded earthquakes with magnitudes equal to or greater than 5.0 in the site vicinity are depicted on Figure 4, Regional Seismicity Map. A partial list of moderate to major magnitude earthquakes that have occurred in the Southern California area within the last 100 years is included in the following table.

LIST OF HISTORIC EARTHQUAKES

Earthquake (Oldest to Youngest)	Date of Earthquake	Magnitude	Distance to Epicenter (Miles)	Direction to Epicenter
San Jacinto-Hemet area	April 21, 1918	6.8	98	ESE
Near Redlands	July 23, 1923	6.3	78	ESE
Long Beach	March 10, 1933	6.4	62	SE
Tehachapi	July 21, 1952	7.5	51	NW
San Fernando	February 9, 1971	6.6	8	ENE
Whittier Narrows	October 1, 1987	5.9	34	SE
Sierra Madre	June 28, 1991	5.8	31	ESE
Landers	June 28, 1992	7.3	120	E
Big Bear	June 28, 1992	6.4	98	E
Northridge	January 17, 1994	6.7	12	S
Hector Mine	October 16, 1999	7.1	129	E

The site could be subjected to strong ground shaking in the event of an earthquake. However, this hazard is common in Southern California and the effects of ground shaking can be mitigated if the proposed structures are designed and constructed in conformance with current building codes and engineering practices.

6.3 Seismic Design Criteria

The following table summarizes site-specific design criteria obtained from the 2013 California Building Code (CBC; Based on the 2012 International Building Code [IBC] and ASCE 7-10), Chapter 16 Structural Design, Section 1613 Earthquake Loads. The data was calculated using the computer program *U.S. Seismic Design Maps*, provided by the USGS. The short spectral response uses a period of 0.2 second. The values presented below are for the risk-targeted maximum considered earthquake (MCE_R).

2013 CBC SEISMIC DESIGN PARAMETERS

Parameter	Value	2013 CBC Reference
Site Class	D	Table 1613.3.2
MCE_R Ground Motion Spectral Response Acceleration – Class B (short), S_S	2.958g	Figure 1613.3.1(1)
MCE_R Ground Motion Spectral Response Acceleration – Class B (1 sec), S_1	0.918g	Figure 1613.3.1(2)
Site Coefficient, F_A	1.0	Table 1613.3.3(1)
Site Coefficient, F_V	1.5	Table 1613.3.3(2)
Site Class Modified MCE_R Spectral Response Acceleration (short), S_{MS}	2.958g	Section 1613.3.3 (Eqn 16-37)
Site Class Modified MCE_R Spectral Response Acceleration – (1 sec), S_{M1}	1.376g	Section 1613.3.3 (Eqn 16-38)
5% Damped Design Spectral Response Acceleration (short), S_{DS}	1.972g	Section 1613.3.4 (Eqn 16-39)
5% Damped Design Spectral Response Acceleration (1 sec), S_{D1}	0.918g	Section 1613.3.4 (Eqn 16-40)

The table below presents the mapped maximum considered geometric mean (MCE_G) seismic design parameters for projects located in Seismic Design Categories of D through F in accordance with ASCE 7-10.

ASCE 7-10 PEAK GROUND ACCELERATION

Parameter	Value	ASCE 7-10 Reference
Mapped MCE_G Peak Ground Acceleration, PGA	1.098g	Figure 22-7
Site Coefficient, F_{PGA}	1.0	Table 11.8-1
Site Class Modified MCE_G Peak Ground Acceleration, PGA_M	1.098g	Section 11.8.3 (Eqn 11.8-1)

The Maximum Considered Earthquake Ground Motion (MCE) is the level of ground motion that has a 2 percent chance of exceedance in 50 years, with a statistical return period of 2,475 years. According to the 2013 California Building Code and ASCE 7-10, the MCE is to be utilized for the evaluation of liquefaction, lateral spreading, seismic settlements, and it is our understanding that the intent of the Building code is to maintain “Life Safety” during a MCE event. The Design Earthquake Ground Motion (DE) is the level of ground motion that has a 10 percent chance of exceedance in 50 years, with a statistical return period of 475 years.

Deaggregation of the MCE peak ground acceleration was performed using the USGS 2008 Probabilistic Seismic Hazard Analysis (PSHA) Interactive Deaggregation online tool. The result of the deaggregation analysis indicates that the predominant earthquake contributing to the MCE peak ground acceleration is characterized as a 6.75 magnitude event occurring at a hypocentral distance of 7.2 kilometers from the site.

Deaggregation was also performed for the Design Earthquake (DE) peak ground acceleration, and the result of the analysis indicates that the predominant earthquake contributing to the DE peak ground acceleration is characterized as a 6.77 magnitude occurring at a hypocentral distance of 9.8 kilometers from the site.

Conformance to the criteria in the above tables for seismic design does not constitute any kind of guarantee or assurance that significant structural damage or ground failure will not occur if a large earthquake occurs. The primary goal of seismic design is to protect life, not to avoid all damage, since such design may be economically prohibitive.

6.4 Liquefaction Potential

Liquefaction is a phenomenon in which loose, saturated, relatively cohesionless soil deposits lose shear strength during strong ground motions. Primary factors controlling liquefaction include intensity and duration of ground motion, gradation characteristics of the subsurface soils, in-situ stress conditions, and the depth to groundwater. Liquefaction is typified by a loss of shear strength in the liquefied layers due to rapid increases in pore water pressure generated by earthquake accelerations.

The current standard of practice, as outlined in the “Recommended Procedures for Implementation of DMG Special Publication 117, Guidelines for Analyzing and Mitigating Liquefaction in California” and “Special Publication 117A, Guidelines for Evaluating and Mitigating Seismic Hazards in California” requires liquefaction analysis to a depth of 50 feet below the lowest portion of the proposed structure. Liquefaction typically occurs in areas where the soils below the water table are composed of poorly consolidated, fine to medium-grained, primarily sandy soil. In addition to the requisite soil conditions, the ground acceleration and duration of the earthquake must also be of a sufficient level to induce liquefaction.

The State of California Seismic Hazard Zone Map for the Newhall Quadrangle (CDMG, 1997) indicates that the site is not located in an area designated as “liquefiable.” In addition, a review of the County of Los Angeles Seismic Safety Element (Leighton, 1990) indicates that the site is not located within an area identified as having a potential for liquefaction. Based on this information and the historic high groundwater level in the area (greater than 55 feet), it is our opinion that the potential for liquefaction and associated ground deformations beneath the site is very low.

6.5 Slope Stability

The topography at the site is relatively level and the topography in the immediate site vicinity slopes gently to the west. The site is not located within an area identified as having a potential for slope instability (City of Santa Clarita, 2001; Los Angeles County, 1990). Additionally, the site is not within an area identified as having a potential for seismic slope instability (CDMG, 1998). There are no known landslides near the site, nor is the site in the path of any known or potential landslides. Therefore, the potential for slope stability hazards to adversely affect the proposed development is considered low.

The planned excavation for the proposed development will be on the order of 12 feet. The excavation will expose Holocene age alluvial deposits that are generally horizontally stratified and lack any well-defined planar features or discontinuities (such as bedding planes or joints) which would act as planes of weakness. The geologic conditions at the site will not result in lateral surcharge loading on the proposed basement walls. However, the sandy alluvial deposits will be prone to local raveling or caving, particularly if localized seepage is present, and a temporary shoring system with lagging will be required.

6.6 Earthquake-Induced Flooding

Earthquake-induced flooding is inundation caused by failure of dams or other water-retaining structures due to earthquakes. Based on a review of the Los Angeles County Safety Element (Leighton, 1990), the site is not located within a potential inundation area for an earthquake-induced dam failure. The probability of earthquake-induced flooding is considered very low.

6.7 Tsunamis, Seiches, and Flooding

The site is not located within a coastal area. Therefore, tsunamis, seismic sea waves, are not considered a significant hazard at the site.

Seiches are large waves generated in enclosed bodies of water in response to ground shaking. No major water-retaining structures are located immediately up gradient from the project site. Flooding from a seismically-induced seiche is considered unlikely.

The site is within an area of minimal flooding (Zone X) as defined by the Federal Emergency Management Agency (FEMA, 2015; LACDPW, 2015b).

6.8 Oil Fields & Methane Potential

Based on a review of the California Division of Oil, Gas and Geothermal Resources (DOGGR) Oil and Gas Well Location Map 254, the site is not located within the limits of an oilfield and oil or gas wells are not located in the immediate site vicinity. However, due to the voluntary nature of record reporting by the oil well drilling companies, wells may be improperly located or not shown on the location map and undocumented wells could be encountered during construction. Any wells encountered will need to be properly abandoned in accordance with the current requirements of the DOGGR.

Since the site is not located within the boundaries of a known oil field, the potential for the presence of methane or other volatile gases at the site is considered low. However, should it be determined that a methane study is required for the proposed development it is recommended that a qualified methane consultant be retained to perform the study and provide mitigation measures as necessary.

6.9 Subsidence

Subsidence occurs when a large portion of land is displaced vertically, usually due to the withdrawal of groundwater, oil, or natural gas. Soils that are particularly subject to subsidence include those with high silt or clay content. The site is not located within an area of known ground subsidence. No large-scale extraction of groundwater, gas, oil, or geothermal energy is occurring or planned at the site or in the general site vicinity. There appears to be little or no potential for ground subsidence due to withdrawal of fluids or gases at the site.

7. CONCLUSIONS AND RECOMMENDATIONS

7.1 General

- 7.1.1 It is our opinion that neither soil nor geologic conditions were encountered during the investigation that would preclude the construction of the proposed development provided the recommendations presented herein are followed and implemented during design and construction.
- 7.1.2 Up to 5 feet of existing artificial fill was encountered during the site investigation. The existing fill encountered is believed to be the result of past grading and construction activities at the site. Deeper fill may exist in other areas of the site that were not directly explored. It is our opinion that the existing fill, in its present condition, is not suitable for direct support of proposed foundations or slabs. The existing fill and site soils are suitable for re-use as engineered fill provided the recommendations in the *Grading* section of this report are followed (see Section 7.4).
- 7.1.3 Groundwater was not encountered during site exploration and the current groundwater table is sufficiently deep that it not expected to be encountered during construction. However, local seepage could be encountered during excavation of the subterranean levels, especially if conducted during the rainy season.
- 7.1.4 Excavations for subterranean levels are anticipated to penetrate through the existing artificial fill and expose competent alluvial soils throughout the excavation bottom.
- 7.1.5 Based on these considerations, the proposed structures may be supported on conventional foundation systems. At the subterranean levels, the conventional foundation system may derive support in the undisturbed alluvial soils at or below a depth of 10 feet. For on-grade portions of the development, the conventional foundation system may derive support in newly placed engineered fill. All foundation excavations must be observed and approved in writing by the Geotechnical Engineer prior to placement of steel or concrete. Recommendations for the design of a conventional foundation system are provided in Section 7.6.
- 7.1.6 As a minimum, the upper 5 feet of existing site soils within the proposed on-grade footprint areas should be excavated and properly compacted for foundation and slab support. Excavation should be conducted as necessary to completely remove all artificial fill and any soft, unsuitable alluvium at the direction of the Geotechnical Engineer (a representative of Geocon). The excavation should extend laterally a minimum distance of three feet beyond the building footprint area or a distance equal to the depth of fill below the foundation, whichever is greater. Recommendations for earthwork are provided in the *Grading* section of this report (see Section 7.4).

- 7.1.7 Where excavation and grading cannot be accomplished due to property line constraints, conventional foundations should be deepened as necessary to derive support in the undisturbed alluvial soils found at or below a depth of 5 feet below the existing ground surface. It is the intent of the Geotechnical Engineer to allow foundations to derive support in competent alluvial soils and newly placed engineered fill for this project, if conditions warrant such an occurrence. All foundation excavations must be observed and approved by the Geotechnical Engineer (a representative of Geocon), prior to placing steel or concrete.
- 7.1.8 Due to the proximity of proposed on-grade theater structure to the proposed subterranean levels, the on-grade structure will impose a surcharge on the subterranean retaining walls. In order to mitigate the surcharge, the subterranean retaining walls may be designed to withstand the surcharge of the proposed adjacent structure. The surcharge loads considered should include dead plus live loads as well as lateral loads. Alternatively, in order to prevent a surcharge on the subterranean retaining walls, the foundations for the proposed on-grade structure may be deepened to a depth that is below the surcharge area of the subterranean foundations. This can be accomplished with pile foundations and a grade beam, if necessary. The surcharge area may be defined by a 1:1 projection up and away from the bottom of the subterranean foundations (see Figure 2). Recommendations for deepened foundations are provided in Section 7.7.
- 7.1.9 In order to minimize or prevent a lateral surcharge on the subterranean levels of the proposed structures, the lateral contribution of all foundation systems within 10 feet of the subterranean structures may be ignored. The required lateral capacity can be accounted for by structural connections to other foundations that are outside of the defined surcharge area.
- 7.1.10 The concrete slabs-on-grade for subterranean levels may derive support directly on the undisturbed alluvial soils at or below a depth of 10 feet. Any soils that are disturbed should be properly compacted for slab support. The concrete slab-on-grade for the ramp should derive support on a minimum of 12 inches of newly placed engineered fill. The existing artificial fill and alluvial soils are suitable for re-use as an engineered fill provided the procedures outlined in the *Grading* section of this report are followed (see Section 7.4).
- 7.1.11 Excavations on the order of 12 feet in vertical height are anticipated for construction of subterranean levels, including foundation depths. Due to the depth of the excavation and the proximity to the property lines, city streets and adjacent offsite structures, excavation of the proposed subterranean levels will require sloping and/or shoring measures in order to provide a stable excavation. Where shoring is required it is recommended that a soldier pile shoring system be utilized. In addition, where the proposed excavation will be deeper than and adjacent to an existing structure, the proposed shoring should be designed to resist the surcharge imposed by the adjacent structure. Recommendations for shoring are provided in Section 7.20.

- 7.1.12 Due to the nature of the proposed design and intent for a subterranean levels, waterproofing of subterranean walls and slabs is suggested. Particular care should be taken in the design and installation of waterproofing to avoid moisture problems, or actual water seepage into the structure through any normal shrinkage cracks which may develop in the concrete walls, floor slab, foundations and/or construction joints. The design and inspection of the waterproofing is not the responsibility of the geotechnical engineer. A waterproofing consultant should be retained in order to recommend a product or method, which would provide protection to subterranean walls, floor slabs and foundations.
- 7.1.13 Foundations for small outlying structures, such as block walls less than 6 feet in height, planter walls or trash enclosures, which will not be tied to the proposed structure, may be supported on conventional foundations deriving support on a minimum of 12 inches of newly placed engineered fill which extends laterally at least 12 inches beyond the foundation area. Where excavation and compaction cannot be performed or is undesirable, foundations may derive support directly in the competent undisturbed alluvial soils found at or below a depth of 24 inches, and should be deepened as necessary to maintain a minimum 12 inch embedment into the recommended bearing materials. If the soils exposed in the excavation bottom are soft or loose, compaction of the soils will be required prior to placing steel or concrete. Compaction of the foundation excavation bottom is typically accomplished with a compaction wheel or mechanical whacker and must be observed and approved by a Geocon representative.
- 7.1.14 Where new paving is to be placed, it is recommended that all existing fill and soft alluvial soils be excavated and properly compacted for paving support. The client should be aware that excavation and compaction of all existing fill and soft alluvial soils in the area of new paving is not required; however, paving constructed over existing uncertified fill or unsuitable alluvial soil may experience increased settlement and/or cracking, and may therefore have a shorter design life and increased maintenance costs. As a minimum, the upper 12 inches of subgrade soil should be scarified and properly compacted for paving support. Paving recommendations are provided in Preliminary Pavement Recommendations section of this report (see Section 7.12).
- 7.1.15 Based on the results of percolation testing performed at the site, a stormwater infiltration system is considered feasible for this project. Recommendations for infiltration are provided in the Stormwater Infiltration section of this report (see Section 7.25).
- 7.1.16 Once the design and foundation loading configuration for the proposed development proceeds to a more finalized plan, the recommendations within this report should be reviewed and revised, if necessary. Based on the final foundation loading configurations, the potential for settlement should be re-evaluated by this office.

- 7.1.17 Any changes in the design, location or elevation, as outlined in this report, should be reviewed by this office. Geocon should be contacted to determine the necessity for review and possible revision of this report.

7.2 Soil and Excavation Characteristics

- 7.2.1 The in-situ soils can be excavated with moderate effort using conventional excavation equipment. Caving should be anticipated in unshored excavations, especially where granular soils are encountered.
- 7.2.2 It is the responsibility of the contractor to ensure that all excavations and trenches are properly shored and maintained in accordance with applicable OSHA rules and regulations to maintain safety and maintain the stability of existing adjacent improvements.
- 7.2.3 All onsite excavations must be conducted in such a manner that potential surcharges from existing structures, construction equipment, and vehicle loads are resisted. The surcharge area may be defined by a 1:1 projection down and away from the bottom of an existing foundation or vehicle load. Penetrations below this 1:1 projection will require special excavation measures such as sloping or shoring. Excavation recommendations are provided in the *Temporary Excavations* section of this report (see Section 7.18).
- 7.2.4 The upper 5 feet of existing site soils encountered during this investigation are considered to have a “very low” expansive potential ($EI = 0$); and are classified as “non-expansive” based on the 2013 California Building Code (CBC) Section 1803.5.3. The soils encountered at the subterranean levels are primarily granular in nature and are considered to be “non-expansive”. Recommendations presented herein assume that the building foundations and slabs will derive support in these materials.

7.3 Minimum Resistivity, pH, and Water-Soluble Sulfate

- 7.3.1 Potential of Hydrogen (pH) and resistivity testing as well as chloride content testing were performed on representative samples of soil to generally evaluate the corrosion potential to surface utilities. The tests were performed in accordance with California Test Method Nos. 643 and 422 and indicate that the soils are considered “mildly corrosive” to “moderately corrosive” with respect to corrosion of buried ferrous metals on site. The results are presented in Appendix B (Figure B10) and should be considered for design of underground structures.

- 7.3.2 Laboratory tests were performed on representative samples of the site materials to measure the percentage of water-soluble sulfate content. Results from the laboratory water-soluble sulfate tests are presented in Appendix B (Figure B10) and indicate that the on-site materials possess “negligible” sulfate exposure to concrete structures as defined by 2013 CBC Section 1904 and ACI 318-11 Sections 4.2 and 4.3.
- 7.3.3 Geocon West, Inc. does not practice in the field of corrosion engineering and mitigation. If corrosion sensitive improvements are planned, it is recommended that a corrosion engineer be retained to evaluate corrosion test results and incorporate the necessary precautions to avoid premature corrosion of buried metal pipes and concrete structures in direct contact with the soils.

7.4 Grading

- 7.4.1 Earthwork should be observed, and compacted fill tested by representatives of Geocon West, Inc. The existing fill and alluvial soil encountered during exploration is suitable for re-use as engineered fill, provided any encountered oversize material (greater than 6 inches) and any encountered deleterious debris are removed.
- 7.4.2 A preconstruction conference should be held at the site prior to the beginning of grading operations with the owner, contractor, civil engineer, geotechnical engineer, and building official in attendance. Special soil handling requirements can be discussed at that time.
- 7.4.3 Grading should commence with the removal of all existing vegetation and existing improvements from the area to be graded. Deleterious debris such as wood and root structures should be exported from the site and should not be mixed with the fill soils. Asphalt and concrete should not be mixed with the fill soils unless approved by the Geotechnical Engineer. All existing underground improvements planned for removal should be completely excavated and the resulting depressions properly backfilled in accordance with the procedures described herein. Once a clean excavation bottom has been established it must be observed and approved in writing by the Geotechnical Engineer (a representative of Geocon West, Inc.).
- 7.4.4 As a minimum, it is recommended that the upper 5 feet of existing earth materials within the proposed on-grade footprint areas be excavated and properly compacted for foundation and slab support. Deeper excavations should be conducted as necessary to remove deeper artificial fill or soft alluvial soil at the direction of the Geotechnical Engineer (a representative of Geocon). The limits of existing fill and/or soft alluvial soils removal will be verified by the Geocon representative during site grading activities. Where excavation and compaction is to be conducted, the excavation should extend laterally a minimum distance of 3 feet beyond the building footprint area, including building appurtenances, or a distance equal to the depth of fill below the foundation, whichever is greater. Where the recommended lateral excavation

cannot be performed due to property line constraints and/or the presence of existing structures, conventional foundations should be deepened as necessary to derive support in the undisturbed alluvial soils found at or below a depth of 5 feet.

- 7.4.5 All excavations must be observed and approved in writing by the Geotechnical Engineer (a representative of Geocon). Prior to placing any fill, the excavation bottom must be proof-rolled with heavy equipment in the presence of the Geotechnical Engineer (a representative of Geocon West, Inc.).
- 7.4.6 The concrete slabs-on-grade for subterranean levels may derive support directly on the undisturbed alluvial soils at or below a depth of 10 feet. Any soils that are disturbed should be properly compacted for slab support. The concrete slab-on-grade for the ramp should derive support on a minimum of 12 inches of newly placed engineered fill.
- 7.4.7 All fill and backfill soils should be placed in horizontal loose layers approximately 6 to 8 inches thick, moisture conditioned to optimum moisture content, and properly compacted to a minimum 90 percent of the maximum dry density in accordance with ASTM D 1557 (latest edition).
- 7.4.8. Where new paving is to be placed, it is recommended that all existing fill and soft alluvium be excavated and properly compacted for paving support. As a minimum, the upper 12 inches of soil should be scarified, moisture conditioned to optimum moisture content, and compacted to at least 95 percent relative compaction, as determined by ASTM Test Method D 1557 (latest edition). Paving recommendations are provided in *Preliminary Pavement Recommendations* section of this report (see Section 7.12).
- 7.4.9 Foundations for small outlying structures, such as block walls less than 6 feet high, planter walls or trash enclosures, which will not be tied to the proposed building, may be supported on conventional foundations deriving support on a minimum of 12 inches of newly placed engineered fill which extends laterally at least 12 inches beyond the foundation area. Where excavation and proper compaction cannot be performed or is undesirable, foundations may derive support directly in the undisturbed alluvial soils found at or below a depth of 24 inches, and should be deepened as necessary to maintain a minimum 12 inch embedment into the recommended bearing materials. If the soils exposed in the excavation bottom are soft or loose, compaction of the soils will be required prior to placing steel or concrete. Compaction of the foundation excavation bottom is typically accomplished with a compaction wheel or mechanical whacker and must be observed and approved by a Geocon representative.

- 7.4.10 Utility trenches should be properly backfilled in accordance with the requirements of the Green Book (latest edition). The pipe should be bedded with clean sands (Sand Equivalent greater than 30) to a depth of at least 1 foot over the pipe, and the bedding material must be inspected and approved in writing by the Geotechnical Engineer (a representative of Geocon). The use of gravel is not acceptable unless used in conjunction with filter fabric to prevent the gravel from having direct contact with soil. The remainder of the trench backfill may be derived from onsite soil or approved import soil, compacted as necessary, until the required compaction is obtained. The use of minimum 2-sack slurry is also acceptable. Prior to placing any bedding materials or pipes, the excavation bottom must be observed and approved in writing by the Geotechnical Engineer (a representative of Geocon).
- 7.4.11 Although not anticipated for this project, all imported fill shall be observed, tested, and approved by Geocon West, Inc. prior to bringing soil to the site. Rocks larger than 6 inches in diameter shall not be used in the fill. If necessary, import soils used as structural fill should have an expansion index less than 20 and corrosivity properties that are equally or less detrimental to that of the existing onsite soils (see Figure B10). Import soils placed in the building area should be placed uniformly across the building pad or in a manner that is approved by the Geotechnical Engineer (a representative of Geocon).
- 7.4.12 All trench and foundation excavation bottoms must be observed and approved in writing by the Geotechnical Engineer (a representative of Geocon), prior to placing bedding materials, fill, steel, gravel, or concrete.

7.5 Shrinkage

- 7.5.1 Shrinkage results when a volume of material removed at one density is compacted to a higher density. A shrinkage factor of between 5 and 10 percent should be anticipated when excavating and compacting the existing fill and alluvium on site to an average relative compaction of 92 percent.
- 7.4.2 If import soils will be utilized in the building pads, the soils must be placed uniformly and at equal thickness at the direction of the Geotechnical Engineer (a representative of Geocon West, Inc.). Soils can be borrowed from non-building pad areas and later replaced with imported soils.

7.6 Foundation Design

- 7.6.1 It is recommended that a conventional foundation system be utilized for support of the proposed structures. At the subterranean levels, the conventional foundation system may derive support in the undisturbed alluvial soils found at or below a depth of 10 feet. Foundations for the proposed on-grade structure may derive support in newly placed engineered fill.
- 7.6.2 Where excavation and grading cannot be performed due to property line constraints, foundations should be deepened as necessary to derive support in the dense undisturbed alluvial soils found at or below a depth of 5 feet below the existing ground surface. Foundations should be deepened as necessary to penetrate through any encountered unsuitable soils to derive support in the competent alluvium. It is the intent of the Geotechnical Engineer to allow building foundations to derive support in both engineered fill and competent alluvial soils for this project, if conditions warrant such an occurrence. All foundation excavations must be observed and approved in writing by the Geotechnical Engineer (a representative of Geocon), prior to placing steel or concrete.
- 7.6.3 Due to the proximity of proposed on-grade theater structure to the proposed subterranean levels, the on-grade structure will impose a surcharge on the subterranean retaining walls. In order to mitigate the surcharge, the subterranean retaining walls may be designed to withstand the surcharge of the proposed adjacent structure. The surcharge loads considered should include dead plus live loads as well as lateral loads. Alternatively, in order to prevent a surcharge on the subterranean retaining walls, the foundations for the proposed on-grade structure may be deepened to a depth that is below the surcharge area of the subterranean foundations. This can be accomplished with pile foundations and a grade beam, if necessary. The surcharge area may be defined by a 1:1 projection up and away from the bottom of the subterranean foundations (see Figure 2). Recommendations for deepened foundations are provided in Section 7.7.
- 7.6.4 In order to minimize or prevent a lateral surcharge on the subterranean levels of the proposed structures, the lateral contribution of all foundation systems within 10 feet of the subterranean structures may be ignored. The required lateral capacity can be accounted for by structural connections to other foundations that are outside of the defined surcharge area.
- 7.6.5 Continuous footings may be designed for an allowable bearing capacity of 2,500 pounds per square foot (psf), and should be a minimum of 12 inches in width, 18 inches in depth below the lowest adjacent grade, and 12 inches into the recommended bearing material.

- 7.6.6 Isolated spread foundations may be designed for an allowable bearing capacity of 3,000 psf, and should be a minimum of 24 inches in width, 18 inches in depth below the lowest adjacent grade, and 12 inches into the recommended bearing material.
- 7.6.7 The allowable soil bearing pressure above may be increased by 250 psf and 500 psf for each additional foot of foundation width and depth, respectively, up to a maximum allowable soil bearing pressure of 4,500 psf.
- 7.6.8 The allowable bearing pressures may be increased by one-third for transient loads due to wind or seismic forces.
- 7.6.9 If depth increases are utilized for the perimeter foundations, this office should be provided a copy of the final construction plans so that the excavation recommendations presented herein could be properly reviewed and revised if necessary.
- 7.6.10 Continuous footings should be reinforced with four No. 4 steel reinforcing bars, two placed near the top of the footing and two near the bottom. Reinforcement for spread footings should be designed by the project structural engineer.
- 7.6.11 The above foundation dimensions and minimum reinforcement recommendations are based on soil conditions and building code requirements only, and are not intended to be used in lieu of those required for structural purposes.
- 7.6.12 No special subgrade presaturation is required prior to placement of concrete. However, the slab and foundation subgrade should be sprinkled as necessary; to maintain a moist condition as would be expected in any concrete placement.
- 7.6.13 Foundation excavations should be observed and approved in writing by the Geotechnical Engineer (a representative of Geocon West, Inc.), prior to the placement of reinforcing steel and concrete to verify that the excavations and exposed soil conditions are consistent with those anticipated. If unanticipated soil conditions are encountered, foundation modifications may be required.
- 7.6.14 This office should be provided a copy of the final construction plans so that the excavation recommendations presented herein could be properly reviewed and revised if necessary.

7.7 Deepened Foundations – End Bearing Piles

- 7.7.1 Deepened foundations consisting of drilled, cast-in-place end-bearing piles should be a minimum of 24 inches in diameter, may derive support in the competent alluvial soils found at and below a depth of 5 feet. Where used with a surcharge zone, foundations should be deepened as necessary to extend below the surcharge zone influence line.

- 7.7.2 Deepened foundations may be designed for an allowable bearing capacity of 6,000 psf, and should be a minimum of 24 inches in diameter and 5 feet below the lowest adjacent grade. The maximum expected static settlement for deepened foundations deriving support in the undisturbed alluvium and designed with a bearing pressure of 6,000 psf is anticipated to be approximately ½ inch. Settlement of the foundation system is expected to occur on initial application of loading.
- 7.7.3 The soil bearing pressures above may be increased by 300 psf and 1,000 psf for each additional foot of foundation diameter and depth, respectively. Where settlements up to ¾ inch are acceptable, a maximum allowable bearing pressure of 12,000 psf may be used. Settlement of the foundation system is expected to occur on initial application of loading.
- 7.7.4 The allowable bearing pressure may be increased by up to one-third for transient loads due to wind or seismic forces. The piles may be connected with a grade beam or structural slab as needed.
- 7.7.5 All drilled pile excavations must be continuously observed by personnel of this firm to verify adequate depth and penetration into the recommended bearing materials. **All loose soils must be completely removed from the bottom of all end-bearing foundation excavations** and must be observed and approved in writing by the Geotechnical Engineer (a representative of Geocon West, Inc.) prior to steel and concrete placement.
- 7.7.6 Casing may be required if caving is experienced in the drilled excavation. The contractor should be prepared to use casing and should have casing available prior to commencement of drilling activities. When casing is used, extreme care should be employed so that the pile is not pulled apart as the casing is withdrawn. At no time should the distance between the surface of the concrete and the bottom of the casing be less than five feet. Continuous observation of the drilling and pouring of the piles by the Geotechnical Engineer (a representative of Geocon West, Inc.), is required.
- 7.7.7 Closely spaced piles should be drilled and filled alternately, with the concrete permitted to set at least eight hours before drilling an adjacent hole. Caisson excavations should be filled with concrete as soon after drilling and inspection as possible; the holes should not be left open overnight unless approved by the Geotechnical Engineer.

7.8 Foundation Settlement

- 7.8.1 The maximum expected static settlement for the mixed-use structure with assumed column loads of 500 kips and wall loads of 6 kips per linear foot, supported on a conventional foundation system designed with a maximum bearing pressure of 4,500 psf, and deriving support in the undisturbed alluvial soils found at and below a depth of 10 feet is estimated to be less than 1¼ inches and occur below the heaviest loaded structural element. Settlement of the foundation system is expected to occur on initial application of loading. Differential settlement is not expected to exceed ⅔ inch over a distance of 20 feet.
- 7.8.2 The maximum expected static settlement for the parking structure with assumed column loads of 600 kips and wall loads of 8 kips per linear foot, supported on a conventional foundation system designed with a maximum bearing pressure of 4,500 psf, and deriving support in the undisturbed alluvial soils found at and below a depth of 10 feet is estimated to be less than 1¾ inches and occur below the heaviest loaded structural element. Settlement of the foundation system is expected to occur on initial application of loading. Differential settlement is not expected to exceed ¾ inch over a distance of 20 feet.
- 7.8.3 The maximum expected static settlement for the theater structure with assumed column loads of 300 kips and wall loads of 4 kips per linear foot, supported on a conventional foundation system designed with a maximum bearing pressure of 4,500 psf and deriving support in in the newly placed engineered fill is estimated to be less than 1¼ inches and occur below the heaviest loaded structural element. Settlement of the foundation system is expected to occur on initial application of loading. Differential settlement is not expected to exceed ⅔ inch over a distance of 20 feet.
- 7.8.4 Once the design and foundation loading configurations for the proposed structures proceeds to a more finalized plan, the estimated settlements presented in this report should be reviewed and revised, if necessary. If the final foundation loading configurations are greater than the assumed loading conditions, the potential for settlement should be reevaluated by this office.

7.9 Miscellaneous Foundations

- 7.9.1 Foundations for small outlying structures, such as block walls less than 6 feet in height, planter walls or trash enclosures which will not be tied to the proposed structure may be supported on conventional foundations bearing on a minimum of 12 inches of newly placed engineered fill which extends laterally at least 12 inches beyond the foundation area. Where excavation and compaction cannot be performed or is undesirable, such as adjacent to property lines, foundations may derive support in the undisturbed alluvial soils found at or below a depth of 24 inches, and should be deepened as necessary to maintain a minimum 12 inch embedment into the recommended bearing materials.

7.9.2 If the soils exposed in the excavation bottom are soft, compaction of the soft soils will be required prior to placing steel or concrete. Compaction of the foundation excavation bottom is typically accomplished with a compaction wheel or mechanical whacker and must be observed and approved by a Geocon representative. Miscellaneous foundations may be designed for a bearing value of 1,500 psf, and should be a minimum of 12 inches in width, 36 inches in depth below the lowest adjacent grade and 12 inches into the recommended bearing material. The allowable bearing pressure may be increased by up to one-third for transient loads due to wind or seismic forces.

7.9.3 Foundation excavations should be observed and approved in writing by the Geotechnical Engineer (a representative of Geocon West, Inc.), prior to the placement of reinforcing steel and concrete to verify that the excavations and exposed soil conditions are consistent with those anticipated.

7.10 Lateral Design

7.10.1 Resistance to lateral loading may be provided by friction acting at the base of foundations, slabs and by passive earth pressure. An allowable coefficient of friction of 0.38 may be used with the dead load forces in the competent alluvial soils or in properly compacted engineered fill.

7.10.2 Passive earth pressure for the sides of foundations and slabs poured against properly compacted engineered fill or competent alluvial soils may be computed as an equivalent fluid having a density of 250 pcf with a maximum earth pressure of 2,500 psf. When combining passive and friction for lateral resistance, the passive component should be reduced by one-third.

7.11 Concrete Slabs-on-Grade

7.11.1 Concrete slabs-on-grade subject to vehicle loading should be designed in accordance with the recommendations in the *Pavement Recommendations* section of this report (Section 7.12).

7.11.2 Subsequent to the recommended grading, concrete slabs-on-grade for structures, not subject to vehicle loading, should be a minimum of 4 inches thick and minimum slab reinforcement should consist of No. 3 steel reinforcing bars placed 18 inches on center in both horizontal directions. Steel reinforcing should be positioned vertically near the slab midpoint.

- 7.11.3 Slabs-on-grade at the ground surface that may receive moisture-sensitive floor coverings or may be used to store moisture-sensitive materials should be underlain by a vapor retarder placed directly beneath the slab. The vapor retarder and acceptable permeance should be specified by the project architect or developer based on the type of floor covering that will be installed. The vapor retarder design should be consistent with the guidelines presented in Section 9.3 of the American Concrete Institute's (ACI) Guide for Concrete Slabs that Receive Moisture-Sensitive Flooring Materials (ACI 302.2R-06) and should be installed in general conformance with ASTM E 1643 (latest edition) and the manufacturer's recommendations. A minimum thickness of 15 mils extruded polyolefin plastic is recommended; vapor retarders which contain recycled content or woven materials are not recommended. The vapor retarder should have a permeance of less than 0.01 perms demonstrated by testing before and after mandatory conditioning is recommended. The vapor retarder should be installed in direct contact with the concrete slab with proper perimeter seal. If the California Green Building Code requirements apply to this project, the vapor retarder should be underlain by 4 inches of clean aggregate. It is important that the vapor retarder be puncture resistant since it will be in direct contact with angular gravel. As an alternative to the clean aggregate suggested in the Green Building Code, it is our opinion that the concrete slab-on-grade may be underlain by a vapor retarder over 4 inches of clean sand (sand equivalent greater than 30), since the sand will serve a capillary break and will minimize the potential for punctures and damage to the vapor barrier.
- 7.11.4 For seismic design purposes, a coefficient of friction of 0.38 may be utilized between concrete slabs and subgrade soils without a moisture barrier, and 0.15 for slabs underlain by a moisture barrier.
- 7.11.5 Exterior slabs for walkways or flatwork, not subject to traffic loads, should be at least 4 inches thick and reinforced with No. 3 steel reinforcing bars placed 18 inches on center in both horizontal directions, positioned near the slab midpoint. Prior to construction of slabs, the upper 12 inches of subgrade should be moistened to optimum moisture content and properly compacted to at least 95 percent relative compaction, as determined by ASTM Test Method D 1557 (latest edition). Crack control joints should be spaced at intervals not greater than 10 feet and should be constructed using saw-cuts or other methods as soon as practical following concrete placement. Crack control joints should extend a minimum depth of one-fourth the slab thickness. The project structural engineer should design construction joints as necessary.

7.11.6 The recommendations of this report are intended to reduce the potential for cracking of slabs due to settlement. However, even with the incorporation of the recommendations presented herein, foundations, stucco walls, and slabs-on-grade may exhibit some cracking due to minor soil movement and/or concrete shrinkage. The occurrence of concrete shrinkage cracks is independent of the supporting soil characteristics. Their occurrence may be reduced and/or controlled by limiting the slump of the concrete, proper concrete placement and curing, and by the placement of crack control joints at periodic intervals, in particular, where re-entrant slab corners occur.

7.12 Preliminary Pavement Recommendations

7.12.1 Where new paving is to be placed, it is recommended that all existing fill and soft or unsuitable alluvial materials be excavated and properly recompacted for paving support. The client should be aware that excavation and compaction of all existing artificial fill and soft alluvium in the area of new paving is not required; however, paving constructed over existing unsuitable material may experience increased settlement and/or cracking, and may therefore have a shorter design life and increased maintenance costs. As a minimum, the upper 12 inches of paving subgrade should be scarified, moisture conditioned to optimum moisture content, and properly compacted to at least 95 percent relative compaction, as determined by ASTM Test Method D 1557 (latest edition).

7.12.2 The following pavement sections are based on an assumed R-Value of 35. Once site grading activities are complete an R-Value should be obtained by laboratory testing to confirm the properties of the soils serving as paving subgrade, prior to placing pavement.

7.12.3 The Traffic Indices listed below are estimates. Geocon does not practice in the field of traffic engineering. The actual Traffic Index for each area should be determined by the project civil engineer. If pavement sections for Traffic Indices other than those listed below are required, Geocon should be contacted to provide additional recommendations. Pavement thicknesses were determined following procedures outlined in the *California Highway Design Manual* (Caltrans). It is anticipated that the majority of traffic will consist of automobile and large truck traffic.

PRELIMINARY PAVEMENT DESIGN SECTIONS

Location	Estimated Traffic Index (TI)	Asphalt Concrete (inches)	Class 2 Aggregate Base (inches)
Automobile Parking And Driveways	4.0	3.0	4.0
Trash Truck & Fire Lanes	7.0	3.5	9.0

- 7.12.4 Asphalt concrete should conform to Section 203-6 of the “*Standard Specifications for Public Works Construction*” (Green Book). Class 2 aggregate base materials should conform to Section 26-1.02A of the “*Standard Specifications of the State of California, Department of Transportation*” (Caltrans). The use of Crushed Miscellaneous Base in lieu of Class 2 aggregate base is acceptable. Crushed Miscellaneous Base should conform to Section 200-2.4 of the “*Standard Specifications for Public Works Construction*” (Green Book).
- 7.12.5 Unless specifically designed and evaluated by the project structural engineer, where exterior concrete paving will be utilized for support of vehicles, it is recommended that the concrete be a minimum of 5 inches of concrete reinforced with No. 3 steel reinforcing bars placed 18 inches on center in both horizontal directions. Concrete paving supporting vehicular traffic should be underlain by a minimum of 4 inches of aggregate base and a properly compacted subgrade. The subgrade and base material should be compacted to 95 percent relative compactions determined by ASTM Test Method D 1557 (latest edition).
- 7.12.6 The performance of pavements is highly dependent upon providing positive surface drainage away from the edge of pavements. Ponding of water on or adjacent to the pavement will likely result in saturation of the subgrade materials and subsequent cracking, subsidence and pavement distress. If planters are planned adjacent to paving, it is recommended that the perimeter curb be extended at least 12 inches below the bottom of the aggregate base to minimize the introduction of water beneath the paving.

7.13 Retaining Wall Design

- 7.13.1 The recommendations presented below are generally applicable to the design of rigid concrete or masonry retaining walls having a maximum height of 12 feet. In the event that walls higher than 12 feet are planned, Geocon should be contacted for additional recommendations.
- 7.13.2 Retaining wall foundations may be designed in accordance with the recommendations provided in the *Foundation Design* section of this report (see Section 7.6).
- 7.13.3 Retaining walls with a level backfill surface that are not restrained at the top should be designed utilizing a triangular distribution of pressure (active pressure) of 30 pcf.
- 7.13.4 Restrained walls are those that are not allowed to rotate more than $0.001H$ (where H equals the height of the retaining portion of the wall in feet) at the top of the wall. Assuming that proper drainage and permanent dewatering is maintained, where walls are restrained from movement at the top, walls may be designed utilizing a triangular distribution of pressure (at-rest pressure) of 50 pcf.

- 7.13.5 The wall pressures provided above assume that the retaining wall will be properly drained preventing the buildup of hydrostatic pressure. If retaining wall drainage is not implemented, the equivalent fluid pressure to be used in design of undrained walls is 90 pcf. The value includes hydrostatic pressures plus buoyant lateral earth pressures.
- 7.13.6 The wall pressures provided above assume that the proposed retaining walls will support relatively undisturbed alluvial soils or engineered fill derived from onsite soils. If import soil will be used to backfill proposed retaining walls, revised earth pressures may be required to account for the geotechnical properties of the import soil used as engineered fill. This should be evaluated once the use of import soil is established. All imported fill shall be observed, tested, and approved by Geocon West, Inc. prior to bringing soil to the site.
- 7.13.7 Additional active pressure should be added for a surcharge condition due to sloping ground, vehicular traffic or adjacent structures and should be designed for each condition as the project progresses.
- 7.13.8 It is recommended that line-load surcharges from adjacent wall footings, use horizontal pressures generated from NAV-FAC DM 7.2. The governing equations are:

$$\text{For } x/H \leq 0.4$$

$$\sigma_H(z) = \frac{0.20 \left(\frac{z}{H} \right) \frac{Q_L}{H}}{\left[0.16 + \left(\frac{z}{H} \right)^2 \right]^2}$$

and

$$\text{For } x/H > 0.4$$

$$\sigma_H(x, z) = \frac{1.26 \left(\frac{x}{H} \right)^2 \left(\frac{z}{H} \right) \frac{Q_L}{H}}{\left[\left(\frac{x}{H} \right)^2 + \left(\frac{z}{H} \right)^2 \right]^2}$$

where x is the distance from the face of the excavation to the vertical line-load, H is the distance from the bottom of the footing to the bottom of excavation, z is the depth at which the horizontal pressure is desired, QL is the vertical line-load and σ_H is the horizontal pressure at depth z.

- 7.13.9 It is recommended that vertical point-loads, from construction equipment outriggers or adjacent building columns use horizontal pressures generated from NAV-FAC DM 7.2. The governing equations are:

$$\text{For } x/H \leq 0.4$$

$$\sigma(z) = \frac{0.28 \times \left(\frac{z}{H}\right)^2}{\left[0.16 + \left(\frac{z}{H}\right)^2\right]^3} \times \frac{Q_p}{H^2}$$

and

$$\text{For } x/H > 0.4$$

$$\sigma(z) = \frac{1.77 \times \left(\frac{x}{H}\right)^2 \times \left(\frac{z}{H}\right)^2}{\left[\left(\frac{x}{H}\right)^2 + \left(\frac{z}{H}\right)^2\right]^3} \times \frac{Q_p}{H^2}$$

then

$$\sigma'_H(z) = \sigma_H(z) \cos^2(1.1\theta)$$

where x is the distance from the face of the excavation to the vertical point-load, H is distance from the outrigger/bottom of column footing to the bottom of excavation, z is the depth at which the horizontal pressure is desired, Q_p is the vertical point-load, σ is the vertical pressure at depth z, θ is the angle between a line perpendicular to the bulkhead and a line from the point-load to half the pile spacing at the bulkhead, and σ_H is the horizontal pressure at depth z.

- 7.13.10 In addition to the recommended earth pressure, the upper 10 feet of the subterranean wall adjacent to the street and parking lot should be designed to resist a uniform lateral pressure of 100 psf, acting as a result of an assumed 300 psf surcharge behind the walls due to normal street traffic. If the traffic is kept back at least 10 feet from the subterranean walls, the traffic surcharge may be neglected.
- 7.13.11 Seismic lateral forces should be incorporated into the design as necessary, and recommendations for seismic lateral forces are presented below.

7.14 Dynamic (Seismic) Lateral Forces

- 7.14.1 The structural engineer should determine the seismic design category for the project in accordance with Section 1613 of the CBC. If the project possesses a seismic design category of D, E, or F, proposed retaining walls in excess of 6 feet in height should be designed with seismic lateral pressure (Section 1803.5.12 of the 2013 CBC).
- 7.14.2 A seismic load of 10 pcf should be used for design of walls that support more than 6 feet of backfill in accordance with Section 1803.5.12 of the 2013 CBC. The seismic load is applied as an equivalent fluid pressure along the height of the wall and the calculated loads result in a maximum load exerted at the base of the wall and zero at the top of the wall. This seismic load

should be applied in addition to the active earth pressure. The earth pressure is based on half of two thirds of PGA_M calculated from ASCE 7-10 Section 11.8.3.

7.15 Retaining Wall Drainage

- 7.15.1 Retaining walls should be provided with a drainage system extended at least two-thirds the height of the wall. At the base of the drain system, a subdrain covered with a minimum of 12 inches of gravel should be installed, and a compacted fill blanket or other seal placed at the surface (see Figure 5). The clean bottom and subdrain pipe, behind a retaining wall, should be observed by the Geotechnical Engineer (a representative of Geocon), prior to placement of gravel or compacting backfill.
- 7.15.2 As an alternative, a plastic drainage composite such as Miradrain or equivalent may be installed in continuous, 4-foot wide columns along the entire back face of the wall, at 8 feet on center. The top of these drainage composite columns should terminate approximately 18 inches below the ground surface, where either hardscape or a minimum of 18 inches of relatively cohesive material should be placed as a cap (see Figure 6). These vertical columns of drainage material would then be connected at the bottom of the wall to a collection panel or a 1-cubic-foot rock pocket drained by a 4-inch subdrain pipe.
- 7.15.3 Subdrainage pipes at the base of the retaining wall drainage system should outlet to an acceptable location via controlled drainage structures. Drainage should not be allowed to flow uncontrolled over descending slopes.
- 7.15.4 Moisture affecting below grade walls is one of the most common post-construction complaints. Poorly applied or omitted waterproofing can lead to efflorescence or standing water. Particular care should be taken in the design and installation of waterproofing to avoid moisture problems, or actual water seepage into the structure through any normal shrinkage cracks which may develop in the concrete walls, floor slab, foundations and/or construction joints. The design and inspection of the waterproofing is not the responsibility of the geotechnical engineer. A waterproofing consultant should be retained in order to recommend a product or method, which would provide protection to subterranean walls, floor slabs and foundations.

7.16 Elevator Pit Design

- 7.16.1 The elevator pit slab and retaining wall should be designed by the project structural engineer. Elevator pits may be designed in accordance with the recommendations in the *Foundation Design* and *Retaining Wall Design* sections of this report (see Sections 7.6 and 7.13).

- 7.16.2 Additional active pressure should be added for a surcharge condition due to sloping ground, vehicular traffic, or adjacent foundations and should be designed for each condition as the project progresses.
- 7.16.3 If retaining wall drainage is to be provided, the drainage system should be designed in accordance with the *Retaining Wall Drainage* section of this report (see Section 7.15).
- 7.16.4 It is suggested that the exterior walls and slab be waterproofed to prevent excessive moisture inside of the elevator pit. Waterproofing design and installation is not the responsibility of the geotechnical engineer.

7.17 Elevator Piston

- 7.17.1 If a plunger-type elevator piston is installed for this project, a deep drilled excavation will be required. It is important to verify that the drilled excavation is not situated immediately adjacent to a foundation or shoring pile, or the drilled excavation could compromise the existing foundation or pile support, especially if the drilling is performed subsequent to the foundation or pile construction.
- 7.17.2 Due to the preliminary nature of the project at this time, it is unknown if a plunger-type elevator piston will be included for this project. If in the future it is determined that a plunger-type elevator piston will be constructed, the location of the proposed elevator should be reviewed by the Geotechnical Engineer to evaluate the setback from foundations and shoring piles. Additional recommendations will be provided as necessary.
- 7.17.3 Casing may be required if caving is experienced in the drilled excavation. The contractor should be prepared to use casing and should have it readily available at the commencement of drilling activities. Continuous observation of the drilling and installation of the elevator piston by the Geotechnical Engineer (a representative of Geocon West, Inc.) is required.
- 7.17.4 The annular space between the piston casing and drilled excavation wall should be filled with a minimum of 1½-sack slurry pumped from the bottom up. As an alternative, pea gravel may be utilized. The use of soil to backfill the annular space is not acceptable.


7.18 Temporary Excavations

- 7.18.1 Excavations on the order of 12 feet in height are anticipated for excavation and construction of the proposed subterranean levels and foundation system. The excavations are expected to expose artificial fill and alluvial soils, which are suitable for vertical excavations up to 5 feet where loose soils or caving sands are not present, and where not surcharged by adjacent traffic or structures.

- 7.18.2 If excavations in close proximity to an adjacent property line and/or structure are required, special excavation measures such as slot-cutting or shoring may be necessary in order to maintain lateral support of offsite improvements. Recommendations for slot-cutting are provided in the following section.
- 7.18.3 Vertical excavations greater than five feet will require sloping and/or shoring measures in order to provide a stable excavation. Where sufficient space is available, temporary unsurcharged embankments could be sloped back at a uniform 1:1 slope gradient or flatter, up to a maximum of 12 feet in height. A uniform slope does not have a vertical portion. Where space is limited, shoring measures will be required. *Shoring* data is provided in Section 7.20 of this report.
- 7.18.4 Where sloped embankments are utilized, the top of the slope should be barricaded to prevent vehicles and storage loads at the top of the slope within a horizontal distance equal to the height of the slope. If the temporary construction embankments are to be maintained during the rainy season, berms are suggested along the tops of the slopes where necessary to prevent runoff water from entering the excavation and eroding the slope faces. Geocon personnel should inspect the soils exposed in the cut slopes during excavation so that modifications of the slopes can be made if variations in the soil conditions occur. All excavations should be stabilized within 30 days of initial excavation.

7.19 Slot Cutting

- 7.19.1 The slot-cutting method employs the earth as a buttress and allows the earth excavation to proceed in phases. Where slot-cutting is used for foundation construction, the proposed construction techniques should be discussed with the structural engineer so that appropriate modifications can be made to the foundation design; such as additional reinforcing or details for doweling.
- 7.19.2 It is recommended that the initial temporary excavation along the property line be sloped back at a uniform 1:1 (H:V) slope gradient or flatter for excavation of the existing soils to the necessary depth. The temporary excavation should not extend below the surcharge area of any adjacent foundations. The surcharge area may be defined by a 1:1 projection down and away from the bottom of an existing foundation. The temporary slope may then be excavated using the slot-cutting (see illustration on the following page).

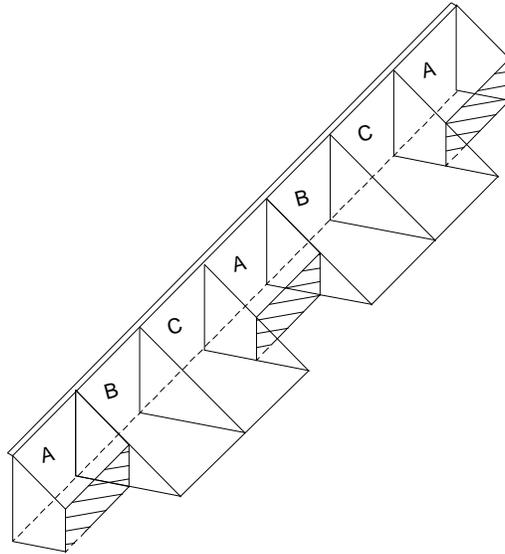

7.19.3 Alternate "A" slots of 8 feet in width may be worked. The remaining earth buttresses ("B" and "C" slots) should also be 8 feet in width. The wall, foundation, or backfill should be completed in the "A" slots to a point where support of the offsite property and/or any existing structures is restored before the "B" slots are excavated. After completing the wall, foundation, or backfill in the "B" slots, finally the "C" slots may be excavated. Slot-cutting is not recommended for vertical excavations greater than 5 feet in height. A surcharge load of 500 pounds per linear foot is included in the slot-cut calculation to account for miscellaneous minor surcharges. The slot-cut calculation should be revised as needed for each surcharge condition as the project progresses. A slot-cut calculation is provided below.

Slot Cut Calculation

Input:

Height of Slots (H) 5.0 feet
 Unit Weight of Soils (γ) 125.0 pcf
 Friction Angle of Soils (ϕ) 30.0 degrees
 Cohesion of Soils (c) 280.0 psf
 Factor of Safety (FS) 1.50
 Factor of Safety = Resistance Force/Driving Force

Coefficient of Lateral Earth Pressure A K_o 0.50

Surcharge Pressure:

Line Load (q_L) 500.0 psf
 Distance Away from Edge of Excavation (X) 0.0 feet

Design Equations
 $b = H/(\tan \alpha)$
 $A = 0.5 * H * b$
 $W = 0.5 * H * b * \gamma$ (per lineal foot of slot width)
 $F_1 = d * W * (\sin \alpha) * (\cos \alpha)$
 $F_2 = d * L$
 $R_1 = d * [W * (\cos^2 \alpha) * (\tan \phi) + (c * b)]$
 $R_2 = 2 * \Delta F$
 $\Delta F = A * [1/3 * \gamma * H * K_o * (\tan \phi) + c]$
FS = Resistance Force/Driving Force
FS = $(R_1 + R_2) / (F_1 + F_2)$

Failure Angle (α) degrees	Base Width of Failure Wedge (b) feet	Area of Failure Wedge (A) feet ²	Weight of Failure Wedge (W) lbs/lineal foot	Driving Force Wedge + Surcharge per lineal foot of Slot Width	Resisting Force Failure Wedge per lineal foot of Slot Width	Resisting Force Side Resistance Force (ΔF) lbs	Allowable Width of Slots* (d) feet
45	5.0	13	1562.5	1031.3	1995.4	4251.8	8.0
46	4.8	12	1508.9	1003.8	1911.6	4105.9	8.0
47	4.7	12	1457.1	976.1	1831.1	3964.8	8.0
48	4.5	11	1406.9	948.2	1753.5	3828.3	8.0
49	4.3	11	1358.3	920.1	1678.8	3696.0	8.0
50	4.2	10	1311.1	891.8	1606.8	3567.6	8.0
51	4.0	10	1265.3	863.4	1537.3	3443.0	8.0
52	3.9	10	1220.8	834.8	1470.4	3321.8	8.0
53	3.8	9	1177.4	806.2	1405.7	3203.9	8.0
54	3.6	9	1135.2	777.6	1343.3	3089.1	8.0
55	3.5	9	1094.1	749.0	1283.1	2977.1	8.0
56	3.4	8	1053.9	720.4	1224.8	2867.8	8.0
57	3.2	8	1014.7	691.9	1168.6	2761.1	8.0
58	3.1	8	976.4	663.5	1114.2	2656.8	8.0
59	3.0	8	938.8	635.2	1061.6	2554.7	8.0
60	2.9	7	902.1	607.1	1010.7	2454.8	8.0
61	2.8	7	866.1	579.3	961.4	2356.8	8.0
62	2.7	7	830.8	551.6	913.7	2260.7	8.0
63	2.5	6	796.1	524.3	867.6	2166.4	8.0
64	2.4	6	762.1	497.3	822.9	2073.7	8.0
65	2.3	6	728.6	470.6	779.5	1982.6	8.0
66	2.2	6	695.7	444.3	737.5	1893.0	8.0
67	2.1	5	663.2	418.4	696.8	1804.8	8.0
68	2.0	5	631.3	392.9	657.3	1717.8	8.0
69	1.9	5	599.8	368.0	619.0	1632.1	8.0
70	1.8	5	568.7	343.5	581.7	1547.5	8.0

*Width of Slots to achieve a minimum of 1.5 Factor of Safety, with a Maximum Allowable Slot Width of 8 feet.

Critical Slot Width with Factor of Safety equal or exceeding 1.5:

$$d_{allow} = 8.0 \text{ feet}$$

7.20 Shoring – Soldier Pile Design and Installation & Underpinning

7.20.1 The following information on the design and installation of shoring is preliminary. Review of the final shoring plans and specifications should be made by this office prior to bidding or negotiating with a shoring contractor.

- 7.20.2 One method of shoring would consist of steel soldier piles, placed in drilled holes and backfilled with concrete. The steel soldier piles may also be installed utilizing high frequency vibration. Where maximum excavation heights are less than 12 feet the soldier piles are typically designed as cantilevers. Where excavations exceed 12 feet or are surcharged, soldier piles may require lateral bracing utilizing drilled tie-back anchors or raker braces to maintain an economical steel beam size and prevent excessive deflection. The size of the steel beam, the need for lateral bracing, and the acceptable shoring deflection should be determined by the project shoring engineer.
- 7.20.3 The design embedment of the shoring pile toes must be maintained during excavation activities. The toes of the perimeter shoring piles should be deepened to take into account any required excavations necessary for foundation excavations and/or adjacent drainage systems.
- 7.20.4 The proposed soldier piles may also be designed as permanent piles. The required pile depths, dimensions, and spacing should be determined and designed by the project structural and shoring engineers. All piles utilized for shoring can also be incorporated into a permanent retaining wall system (shotcrete wall) and should be designed in accordance with the earth pressure provided in the *Retaining Wall Design* section of this report (see Section 7.13).
- 7.20.5 Drilled cast-in-place soldier piles should be placed no closer than three diameters on center. The minimum diameter of the piles is 18 inches. Structural concrete should be used for the soldier piles below the excavation; lean-mix concrete may be employed above that level. As an alternative, lean-mix concrete may be used throughout the pile where the reinforcing consists of a wideflange section. The slurry must be of sufficient strength to impart the lateral bearing pressure developed by the wideflange section to the soil. For design purposes, an allowable passive value for the soils below the bottom plane of excavation may be assumed to be 320 psf per foot. Where piles are installed by vibration techniques, the passive pressure may be assumed to mobilize across a width equal to the two times the dimension of the beam flange. The allowable passive value may be doubled for isolated piles spaced a minimum of three times the pile diameter. To develop the full lateral value, provisions should be implemented to assure firm contact between the soldier piles and the undisturbed alluvium.
- 7.20.6 Groundwater was not encountered during exploration, and groundwater is not expected to be encountered during construction. However, should groundwater or seepage be encountered during pile installation, the contractor should be prepared. Piles placed below the water level require the use of a tremie to place the concrete into the bottom of the hole. A tremie should consist of a rigid, water-tight tube having a diameter of not less than 6 inches with a hopper at the top. The tube should be equipped with a device that will close the discharge end and prevent water from entering the tube while it is being charged with concrete. The tremie should be supported so as to permit free movement of the discharge end over the entire top surface of the work and to permit rapid lowering when necessary to retard or stop the flow of concrete.


The discharge end should be closed at the start of the work to prevent water entering the tube and should be entirely sealed at all times, except when the concrete is being placed. The tremie tube should be kept full of concrete. The flow should be continuous until the work is completed and the resulting concrete seal should be monolithic and homogeneous. The tip of the tremie tube should always be kept about 5 feet below the surface of the concrete and definite steps and safeguards should be taken to insure that the tip of the tremie tube is never raised above the surface of the concrete.

- 7.20.7 A special concrete mix should be used for concrete to be placed below water. The design should provide for concrete with an unconfined compressive strength psi of 1,000 pounds per square inch (psi) over the initial job specification. An admixture that reduces the problem of segregation of paste/aggregates and dilution of paste should be included. The slump should be commensurate to any research report for the admixture, provided that it should also be the minimum for a reasonable consistency for placing when water is present.
- 7.20.8 Caving is likely to occur and the contractor should have casing available prior to commencement of pile excavation. When casing is used, extreme care should be employed so that the pile is not pulled apart as the casing is withdrawn. At no time should the distance between the surface of the concrete and the bottom of the casing be less than 5 feet. As an alternative, piles may be vibrated into place; however, there is always a risk that excessive vibrations in sandy soils could induce settlements and distress to adjacent offsite improvements. Continuous observation of the drilling and pouring of the piles by the Geotechnical Engineer (a representative of Geocon West, Inc.), is required.
- 7.20.9 If a vibratory method of soldier pile installation is utilized, predrilling may be performed prior to installation of the steel beams. If predrilling is performed, it is recommended that the bore diameter be at least 2 inches smaller than the largest dimension of the pile to prevent excessive loss in the frictional component of the pile capacity. Predrilling should not be conducted below the proposed excavation bottom.
- 7.20.10 If a vibratory method is utilized, the owner should be aware of the potential risks associated with vibratory efforts, which typically involve inducing settlement within the vicinity of the pile which could result in a potential for damage to existing improvements in the area.
- 7.20.11 The level of vibration that results from the installation of the piles should not exceed a threshold where occupants of nearby structures are disturbed, despite higher vibration tolerances that a building may endure without deformation or damage. The main parameter used for vibration assessment is peak particle velocity in units of inch per second (in/sec). The acceptable range of peak particle velocity should be evaluated based on the age and condition of adjacent structures, as well as the tolerance of human response to vibration.

- 7.20.12 Based on Table 19 of the *Transportation and Construction Induced Vibration Guidance Manual* (Caltrans 2004), a continuous source of vibrations (ex. vibratory pile driving) which generates a maximum peak particle velocity of 0.5 in/sec is considered tolerable for modern industrial/commercial buildings and new residential structures. The Client should be aware that a lower value may be necessary if older or fragile structures are in the immediate vicinity of the site.
- 7.20.13 Vibrations should be monitored and record with seismographs during pile installation to detect the magnitude of vibration and oscillation experienced by adjacent structures. If the vibrations exceed the acceptable range during installation, the shoring contractor should modify the installation procedure to reduce the values to within the acceptable range. Vibration monitoring is not the responsibility of the Geotechnical Engineer.
- 7.20.14 Geocon does not practice in the field of vibration monitoring. If construction techniques will be implemented, it is recommended that qualified consultant be retained to provide site specific recommendations for vibration thresholds and monitoring.
- 7.20.15 The frictional resistance between the soldier piles and retained soil may be used to resist the vertical component of the anchor load. The coefficient of friction may be taken as 0.38 based on uniform contact between the steel beam and lean-mix concrete and retained earth. The portion of soldier piles below the plane of excavation may also be employed to resist the downward loads. The downward capacity may be determined using a frictional resistance of 500 psf per foot.
- 7.20.16 Due to the nature of the site soils, it is expected that continuous lagging between soldier piles will be required. However, it is recommended that the exposed soils be observed by the Geotechnical Engineer (a representative of Geocon West, Inc.), to verify the presence of any competent, cohesive soils and the areas where lagging may be omitted.
- 7.20.17 The time between lagging excavation and lagging placement should be as short as possible soldier piles should be designed for the full-anticipated pressures. Due to arching in the soils, the pressure on the lagging will be less. It is recommended that the lagging be designed for the full design pressure but be limited to a maximum of 400 psf.
- 7.20.18 For the design of shoring, it is recommended that an equivalent fluid pressure based on the following table, be utilized for design. A diagram depicting the trapezoidal pressure distribution of lateral earth pressure is provided below the table.

HEIGHT OF SHORING (FEET)	EQUIVALENT FLUID PRESSURE (Pounds Per Cubic Foot) (ACTIVE PRESSURE)	EQUIVALENT FLUID PRESSURE Trapezoidal (Where H is the height of the shoring in feet)
Up to 12	25	16H

Trapezoidal Distribution of Pressure

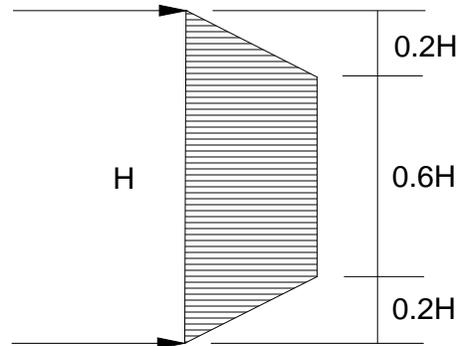

- 7.20.19 It is very important to note that active pressures can only be achieved when movement in the soil (earth wall) occurs. If movement in the soil is not acceptable, such as adjacent to an existing structure, or the pile is restrained from movement by bracing or a tie back anchor, an at-rest pressure of 50 pcf should be considered for design purposes.
- 7.20.20 Where a combination of sloped embankment and shoring is utilized, the pressure will be greater and must be determined for each combination. Additional active pressure should be added for a surcharge condition due to sloping ground, vehicular traffic, or adjacent structures and must be determined for each combination.

7.20.21 It is recommended that line-load surcharges from adjacent wall footings, use horizontal pressures generated from NAV-FAC DM 7.2. The governing equations are:

$$\text{For } x/H \leq 0.4$$

$$\sigma_H(z) = \frac{0.20 \left(\frac{z}{H} \right) \frac{Q_L}{H}}{\left[0.16 + \left(\frac{z}{H} \right)^2 \right]^2}$$

and

$$\text{For } x/H > 0.4$$

$$\sigma_H(x, z) = \frac{1.26 \left(\frac{x}{H} \right)^2 \left(\frac{z}{H} \right) \frac{Q_L}{H}}{\left[\left(\frac{x}{H} \right)^2 + \left(\frac{z}{H} \right)^2 \right]^2}$$

where x is the distance from the face of the excavation to the vertical line-load, H is the distance from the bottom of the footing to the bottom of excavation, z is the depth at which the horizontal pressure is desired, QL is the vertical line-load and σ_H is the horizontal pressure at depth z.

7.20.22 It is recommended that vertical point-loads, from construction equipment outriggers or adjacent building columns use horizontal pressures generated from NAV-FAC DM 7.2. The governing equations are:

$$\text{For } x/H \leq 0.4$$

$$\sigma(z) = \frac{0.28 \times \left(\frac{z}{H} \right)^2}{\left[0.16 + \left(\frac{z}{H} \right)^2 \right]^3} \times \frac{Q_p}{H^2}$$

and

$$\text{For } x/H > 0.4$$

$$\sigma(z) = \frac{1.77 \times \left(\frac{x}{H} \right)^2 \times \left(\frac{z}{H} \right)^2}{\left[\left(\frac{x}{H} \right)^2 + \left(\frac{z}{H} \right)^2 \right]^3} \times \frac{Q_p}{H^2}$$

then

$$\sigma'_H(z) = \sigma_H(z) \cos^2(1.1\theta)$$

where x is the distance from the face of the excavation to the vertical point-load, H is distance from the outrigger/bottom of column footing to the bottom of excavation, z is the depth at which the horizontal pressure is desired, Q_p is the vertical point-load, σ is the vertical pressure at depth z , Θ is the angle between a line perpendicular to the bulkhead and a line from the point-load to half the pile spacing at the bulkhead, and σ_H is the horizontal pressure at depth z .

- 7.20.23 In addition to the recommended earth pressure, the upper 10 feet of the shoring adjacent to the street or driveway areas should be designed to resist a uniform lateral pressure of 100 psf, acting as a result of an assumed 300 psf surcharge behind the shoring due to normal street traffic. If the traffic is kept back at least 10 feet from the shoring, the traffic surcharge may be neglected.
- 7.20.24 It is difficult to accurately predict the amount of deflection of a shored embankment. It should be realized that some deflection will occur. It is recommended that the deflection be minimized to prevent damage to existing structures and adjacent improvements. Where public right-of-ways are present or adjacent offsite structures do not surcharge the shoring excavation, the shoring deflection should be limited to less than 1 inch at the top of the shored embankment. Where offsite structures are within the shoring surcharge area it is recommended that the beam deflection be limited to less than $\frac{1}{2}$ inch at the elevation of the adjacent offsite foundation, and no deflection at all if deflections will damage existing structures. The allowable deflection is dependent on many factors, such as the presence of structures and utilities near the top of the embankment, and will be assessed and designed by the project shoring engineer.
- 7.20.25 Because of the depth of the excavation, some means of monitoring the performance of the shoring system is suggested. The monitoring should consist of periodic surveying of the lateral and vertical locations of the tops of all soldier piles and the lateral movement along the entire lengths of selected soldier piles.
- 7.20.26 Due to the depth of the depth of the excavation and proximity to adjacent structures, it is suggested that prior to excavation the existing improvements be inspected to document the present condition. For documentation purposes, photographs should be taken of preconstruction distress conditions and level surveys of adjacent grade and pavement should be considered. During excavation activities, the adjacent structures and pavement should be periodically inspected for signs of distress. In the even that distress or settlement is noted, an investigation should be performed and corrective measures taken sot that continued or worsened distress or settlement is mitigated. Documentation and monitoring of the offsite structures and improvements is not the responsibility of the geotechnical engineer.

7.21 Tie-Back Anchors

7.21.1 Tie-back anchors may be used with the soldier pile wall system to resist lateral loads. Post-grouted friction anchors are recommended. For design purposes, it may be assumed that the active wedge adjacent to the shoring is defined by a plane drawn 35 degrees with the vertical through the bottom plane of the excavation. Friction anchors should extend a minimum of 20 feet beyond the potentially active wedge and to greater lengths if necessary to develop the desired capacities. The locations and depths of all offsite utilities should be thoroughly checked and incorporated into the drilling angle design for the tie-back anchors.

7.21.2 The capacities of the anchors should be determined by testing of the initial anchors as outlined in a following section. Only the frictional resistance developed beyond the active wedge would be effective in resisting lateral loads. Anchors should be placed at least 6 feet on center to be considered isolated. For preliminary design purposes, it is estimated that drilled friction anchors constructed without utilizing post-grouting techniques will develop average skin frictions (reduced for buoyancy) as follows:

- 5 feet below the top of the excavation – 760 pounds per square foot

7.21.3 Depending on the techniques utilized, and the experience of the contractor performing the installation, a maximum allowable friction capacity of 2.4 kips per linear foot for post-grouted anchors (for a minimum 20 foot length beyond the active wedge) may be assumed for design purposes. Only the frictional resistance developed beyond the active wedge should be utilized in resisting lateral loads.

7.22 Anchor Installation

7.22.1 Tied-back anchors are typically installed between 20 and 40 degrees below the horizontal; however, occasionally alternative angles are necessary to avoid existing improvements and utilities. The locations and depths of all offsite utilities should be thoroughly checked prior to design and installation of the tie-back anchors. Caving of the anchor shafts, particularly within sand and gravel deposits or seepage zones, should be anticipated during installation and provisions should be implemented in order to minimize such caving. It is suggested that hollow-stem auger drilling equipment be used to install the anchors. The anchor shafts should be filled with concrete by pumping from the tip out, and the concrete should extend from the tip of the anchor to the active wedge. In order to minimize the chances of caving, it is recommended that the portion of the anchor shaft within the active wedge be backfilled with sand before testing the anchor. This portion of the shaft should be filled tightly and flush with the face of the excavation. The sand backfill should be placed by pumping; the sand may contain a small amount of cement to facilitate pumping.

7.23 Anchor Testing

- 7.23.1 All of the anchors should be tested to at least 150 percent of design load. The total deflection during this test should not exceed 12 inches. The rate of creep under the 150 percent test load should not exceed 0.1 inch over a 15-minute period in order for the anchor to be approved for the design loading.
- 7.23.2 At least ten percent of the anchors should be selected for "quick" 200 percent tests and three additional anchors should be selected for 24-hour 200 percent tests. The purpose of the 200 percent tests is to verify the friction value assumed in design. The anchors should be tested to develop twice the assumed friction value. These tests should be performed prior to installation of additional tiebacks. Where satisfactory tests are not achieved on the initial anchors, the anchor diameter and/or length should be increased until satisfactory test results are obtained.
- 7.23.3 The total deflection during the 24-hour 200 percent test should not exceed 12 inches. During the 24-hour tests, the anchor deflection should not exceed 0.75 inches measured after the 200 percent test load is applied.
- 7.23.4 For the "quick" 200 percent tests, the 200 percent test load should be maintained for 30 minutes. The total deflection of the anchor during the 200 percent quick tests should not exceed 12 inches; the deflection after the 200 percent load has been applied should not exceed 0.25 inch during the 30-minute period.
- 7.23.5 After a satisfactory test, each anchor should be locked-off at the design load. This should be verified by rechecking the load in the anchor. The load should be within 10 percent of the design load. A representative of this firm should observe the installation and testing of the anchors.

7.24 Internal Bracing

- 7.24.1 Rakers may be utilized to brace the soldier piles in lieu of tieback anchors. The raker bracing could be supported laterally by temporary concrete footings (deadmen) or by the permanent, interior footings. For design of such temporary footings or deadmen, poured with the bearing surface normal to rakers inclined at 45 degrees, a bearing value of 1,500 psf may be used, provided the shallowest point of the footing is at least one foot below the lowest adjacent grade. The structural engineer should review the shoring plans to determine if raker footings conflict with the structural foundation system. The client should be aware that the utilization of rakers could significantly impact the construction schedule due to their intrusion into the construction site and potential interference with equipment.

7.25 Stormwater Infiltration

7.25.1 During the October 5, 2015, site exploration, borings B4 and B7 were utilized to perform percolation testing. The borings were advanced to the depths listed in the table below. Slotted casing was placed in the borings, and the annular space between the casing and excavation was filled with filter pack. The borings were then filled with water to pre-saturate the soils. On October 6, 2015, the casings were refilled with water and percolation test readings were performed after repeated flooding of the cased excavation. Based on the test results, the average infiltration rate (adjusted percolation rate), for the earth materials encountered, is provided in the following table. The field-measured percolation rates have been adjusted to infiltration rates in accordance with the County of Los Angeles Department of Public Works GMED *Guidelines for Design, Investigation, and Reporting Low Impact Development Stormwater Infiltration* (June 2014). Additional correction factors may be required and should be applied by the engineer in responsible charge of the design of the stormwater infiltration system and based on applicable guidelines.

Boring	Infiltration Depth (ft.)	Average Infiltration Rate (in / hour)
B4	15-20½	5.8
B7	15-20½	8.8

7.25.2 The results of the percolation testing indicate that the soils at the locations and depths listed in the table above are conducive to infiltration, and it is our opinion that the site is suitable for infiltration of stormwater.

7.25.3 It is our opinion that the introduction of stormwater at the depths and locations indicated above will not induce excessive hydro-consolidation, will not create a perched groundwater condition, will not affect soil structure interaction of existing or proposed foundations due to expansive soils, will not saturate soils supported by existing or proposed retaining walls, and will not increase the potential for liquefaction. Resulting settlements are anticipated to be less than ¼ inch, if any.

7.25.4 The infiltration system must be located such that the closest distance between an adjacent foundation is at least 10 feet in all directions from the zone of saturation. The zone of saturation may be assumed to project downward from the discharge of the infiltration facility at a gradient of 1:1. Additional property line or foundation setbacks may be required by the governing jurisdiction and should be incorporated into the stormwater infiltration system design as necessary.

- 7.25.5 Where a ten foot horizontal setback cannot be maintained between the infiltration system and an adjacent footing, the proposed stormwater infiltration system must be designed to resist the surcharge from the adjacent foundation. The foundation surcharge line may be assumed to project down away from the bottom of the foundation at a 1:1 gradient. The stormwater infiltration system must still be sufficiently deep to maintain the 10-foot vertical offset between the bottom of the footing and the zone of saturation.
- 7.25.6 Subsequent to the placement of the infiltration system, it is acceptable to backfill the resulting void space between the excavation sidewalls and the infiltration system with minimum two-sack slurry provided the slurry is not placed in the infiltration zone. It is recommended that pea gravel be utilized adjacent to the infiltration zone so communication of water to the soil is not hindered.
- 7.25.7 Due to the preliminary nature of the project at this time, the type of stormwater infiltration system and location of the stormwater infiltration systems has not yet been determined. The design drawings should be reviewed and approved by the Geotechnical Engineer. The installation of the stormwater infiltration system should be observed and approved by the Geotechnical Engineer (a representative of Geocon).

7.26 Surface Drainage

- 7.26.1 Proper surface drainage is critical to the future performance of the project. Uncontrolled infiltration of irrigation excess and storm runoff into the soils can adversely affect the performance of the planned improvements. Saturation of a soil can cause it to lose internal shear strength and increase its compressibility, resulting in a change in the original designed engineering properties. Proper drainage should be maintained at all times.
- 7.26.2 All site drainage should be collected and controlled in non-erosive drainage devices. Drainage should not be allowed to pond anywhere on the site, and especially not against any foundation or retaining wall. The site should be graded and maintained such that surface drainage is directed away from structures in accordance with 2013 CBC 1804.3 or other applicable standards. In addition, drainage should not be allowed to flow uncontrolled over any descending slope. Discharge from downspouts, roof drains and scuppers are not recommended onto unprotected soils within five feet of the building perimeter. Planters which are located adjacent to foundations should be sealed to prevent moisture intrusion into the soils providing foundation support. Landscape irrigation is not recommended within 5 feet of the building perimeter footings except when enclosed in protected planters.
- 7.26.3 Positive site drainage should be provided away from structures, pavement, and the tops of slopes to swales or other controlled drainage structures. The building pad and pavement areas should be fine graded such that water is not allowed to pond.

7.26.4 Landscaping planters immediately adjacent to paved areas are not recommended due to the potential for surface or irrigation water to infiltrate the pavement's subgrade and base course. Either a subdrain, which collects excess irrigation water and transmits it to drainage structures, or an impervious above-grade planter boxes should be used. In addition, where landscaping is planned adjacent to the pavement, it is recommended that consideration be given to providing a cutoff wall along the edge of the pavement that extends at least 12 inches below the base material.

7.27 Plan Review

7.27.1 Grading, foundation, and shoring plans should be reviewed by the Geotechnical Engineer (a representative of Geocon West, Inc.), prior to finalization to verify that the plans have been prepared in substantial conformance with the recommendations of this report and to provide additional analyses or recommendations.

LIMITATIONS AND UNIFORMITY OF CONDITIONS


1. The recommendations of this report pertain only to the site investigated and are based upon the assumption that the soil conditions do not deviate from those disclosed in the investigation. If any variations or undesirable conditions are encountered during construction, or if the proposed construction will differ from that anticipated herein, Geocon West, Inc. should be notified so that supplemental recommendations can be given. The evaluation or identification of the potential presence of hazardous or corrosive materials was not part of the scope of services provided by Geocon West, Inc.
2. This report is issued with the understanding that it is the responsibility of the owner, or of his representative, to ensure that the information and recommendations contained herein are brought to the attention of the architect and engineer for the project and incorporated into the plans, and the necessary steps are taken to see that the contractor and subcontractors carry out such recommendations in the field.
3. The findings of this report are valid as of the date of this report. However, changes in the conditions of a property can occur with the passage of time, whether they are due to natural processes or the works of man on this or adjacent properties. In addition, changes in applicable or appropriate standards may occur, whether they result from legislation or the broadening of knowledge. Accordingly, the findings of this report may be invalidated wholly or partially by changes outside our control. Therefore, this report is subject to review and should not be relied upon after a period of three years.
4. The firm that performed the geotechnical investigation for the project should be retained to provide testing and observation services during construction to provide continuity of geotechnical interpretation and to check that the recommendations presented for geotechnical aspects of site development are incorporated during site grading, construction of improvements, and excavation of foundations. If another geotechnical firm is selected to perform the testing and observation services during construction operations, that firm should prepare a letter indicating their intent to assume the responsibilities of project geotechnical engineer of record. A copy of the letter should be provided to the regulatory agency for their records. In addition, that firm should provide revised recommendations concerning the geotechnical aspects of the proposed development, or a written acknowledgement of their concurrence with the recommendations presented in our report. They should also perform additional analyses deemed necessary to assume the role of Geotechnical Engineer of Record.

LIST OF REFERENCES

- Bryant, W.A. and Hart, E.W., 2007, *Fault-Rupture Hazard Zones in California, Alquist-Priolo Earthquake Fault Zoning Act with Index to Earthquake Fault Zone Maps*, California Division of Mines and Geology Special Publication 42, interim revision.
- California Department of Water Resources, 2015, *Groundwater Level Data by Township, Range, and Section*, Web Site Address: http://www.water.ca.gov/waterdatalibrary/groundwater/hydrographs/index_trs.cfm.
- California Department of Water Resources, 1961, *Planned Utilization of Groundwater Basins of the Coastal Plain of Los Angeles County*, Bulletin 104, Appendix A.
- California Division of Mines and Geology, 1998; *State of California Seismic Hazard Zones, Newhall Quadrangle*, Official Map, Released: February 1, 1998.
- California Division of Mines and Geology, 1997, *Seismic Hazard Evaluation of the Newhall 7.5-Minute Quadrangle, Los Angeles County, California*, Open File Report 97-11.
- California Division of Oil, Gas and Geothermal Resources, 2015. Division of Oil, Gas, and Geothermal Resources Well Finder, <http://maps.conservation.ca.gov/doggr/index.html#close>.
- California Division of Oil, Gas and Geothermal Resources (DOGGR), 2006, *Regional Wildcat Map, Los Angeles and Ventura Counties*, Map 254.
- California Geological Survey, 2015, www.quake.ca.gov/gmaps/WH/regulatory_maps.htm.
- California Geological Survey, 2015, *California Geological Survey – Alquist-Priolo Earthquake Fault Zones*, www.conservation.ca.gov/cgs/rghm/ap/Pages/Index.aspx.
- Dibblee, T. W., Jr., 1996, *Geologic Map of the Newhall Quadrangle, Los Angeles County, California*, Dibblee Foundation Map # DF-56.
- FEMA, 2015, Online Flood Hazard Maps, *Flood Insurance Rate Map, Los Angeles County, California and Unincorporated Areas, Map Number 06037C0820F, Date Accessed: October 2, 2015*, <http://www.esri.com/hazards/index.html>.
- Jennings, C. W. and Bryant, W. A., 2010, *Fault Activity Map of California*, California Geological Survey Geologic Data Map No. 6.
- Leighton and Associates, Inc., 1990, *Technical Appendix to the Safety Element of the Los Angeles County General Plan, Hazard Reduction in Los Angeles County*.
- Los Angeles County Department of Public Works, 2015a, Ground Water Wells Website, <http://dpw2.co.la.ca.us/website/wells/viewer.asp>.
- Los Angeles County Department of Public Works, 2015b, Flood Zone Determination Website, <http://dpw.lacounty.gov/apps/wmd/floodzone/map.htm>.
- Los Angeles, County of, 1990, *Safety Element of the General Plan*.

LIST OF REFERENCES (CONTINUED)

- Santa Clarita, City of, 2001, *City of Santa Clarita General Plan*.
- Topozada, T., Branum, D., Petersen, M, Hallstrom, C., and Reichle, M., 2000, *Epicenters and Areas Damaged by $M > 5$ California Earthquakes, 1800 – 1999*, California Geological Survey, Map Sheet 49.
- Treiman, J. A., 1986, *Landslide Hazards in the East Half of the Newhall Quadrangle, Los Angeles County, California*, Landslide Hazard Identification Map No. 7, California Division of Mines and Geology, Open-File Report 86-16 LA.
- U.S. Geological Survey, 1972, *Newhall 7.5-Minute Topographic Map*.
- Ziony, J. I., and Jones, L. M., 1989, *Map Showing Late Quaternary Faults and 1978–1984 Seismicity of the Los Angeles Region, California*, U.S. Geological Survey Miscellaneous Field Studies Map MF-1964.

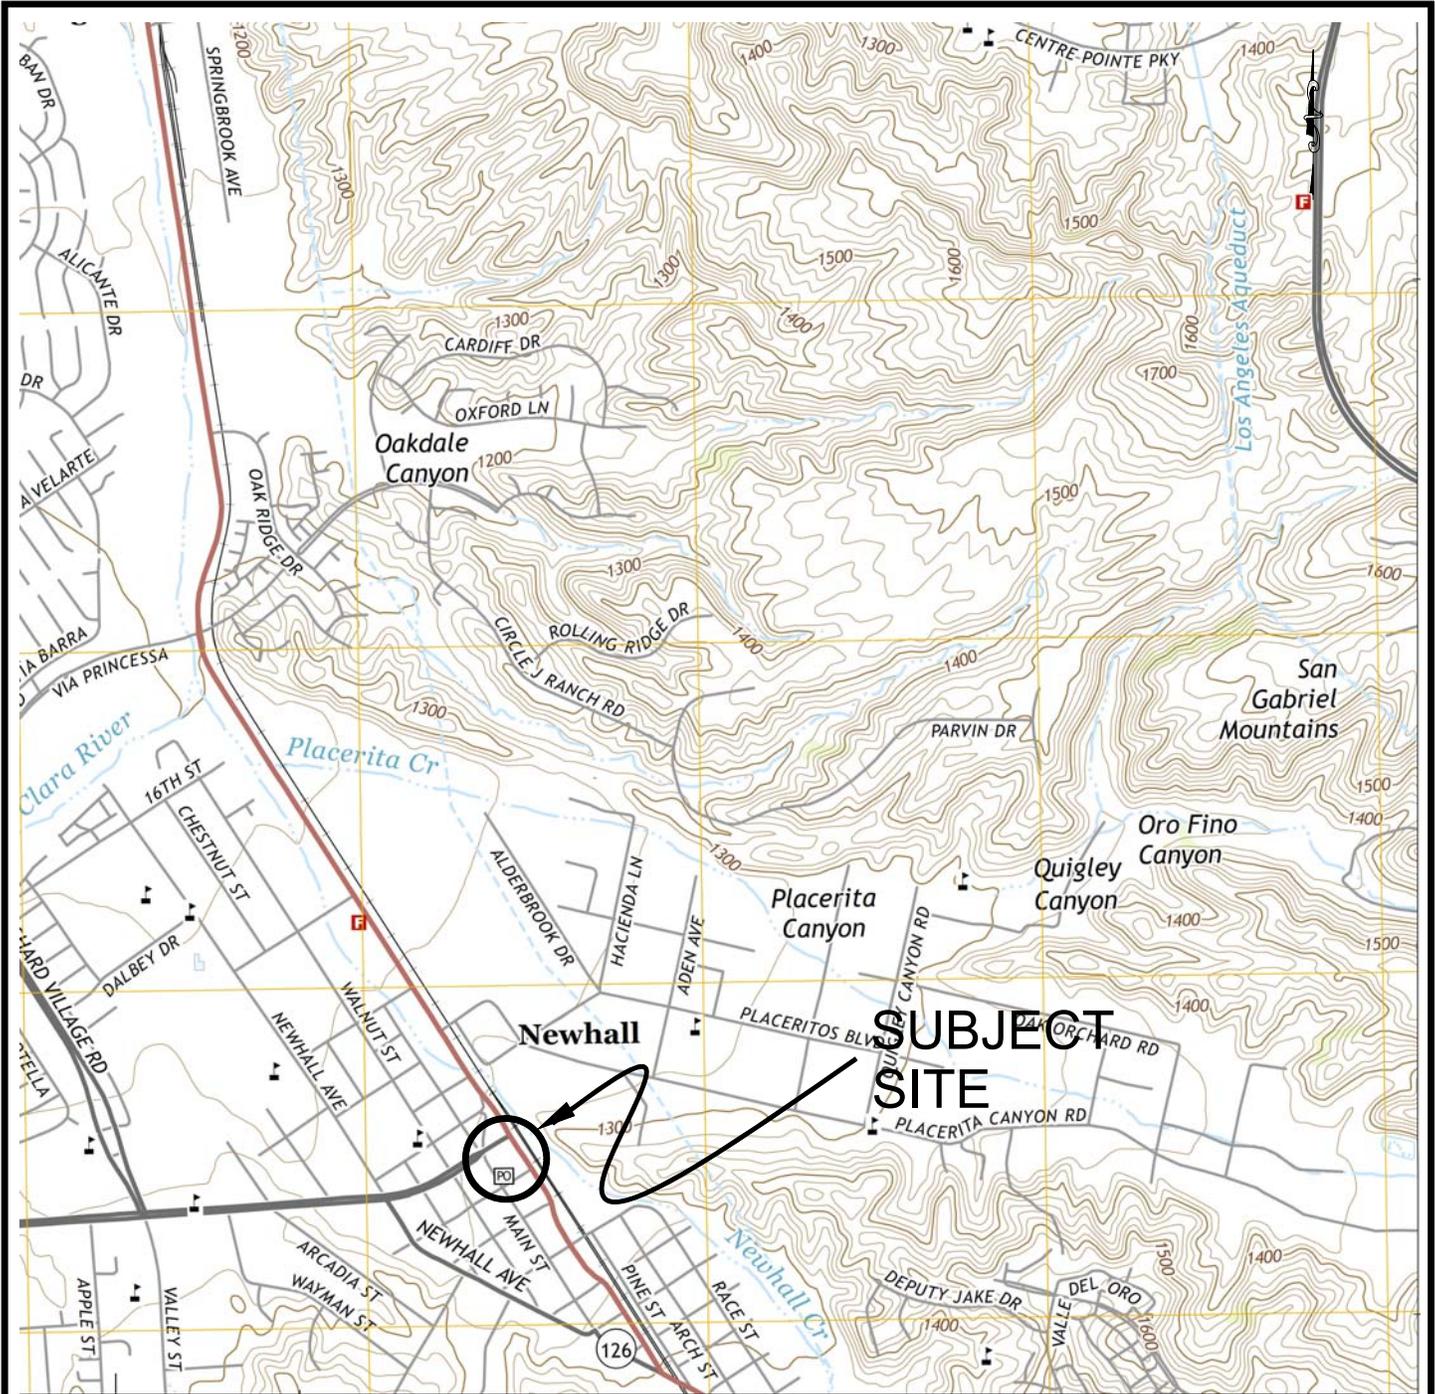

REFERENCE: U.S.G.S. TOPOGRAPHIC MAPS, 7.5 MINUTE SERIES, NEWHALL, CA QUADRANGLE

GEOCON
WEST, INC.




ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: RMA	CHECKED BY: SFK
-----------------	-----------------

VICINITY MAP

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC.
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA



NOV. 10, 2015	PROJECT NO. A9332-06-01	FIG. 1
---------------	-------------------------	--------

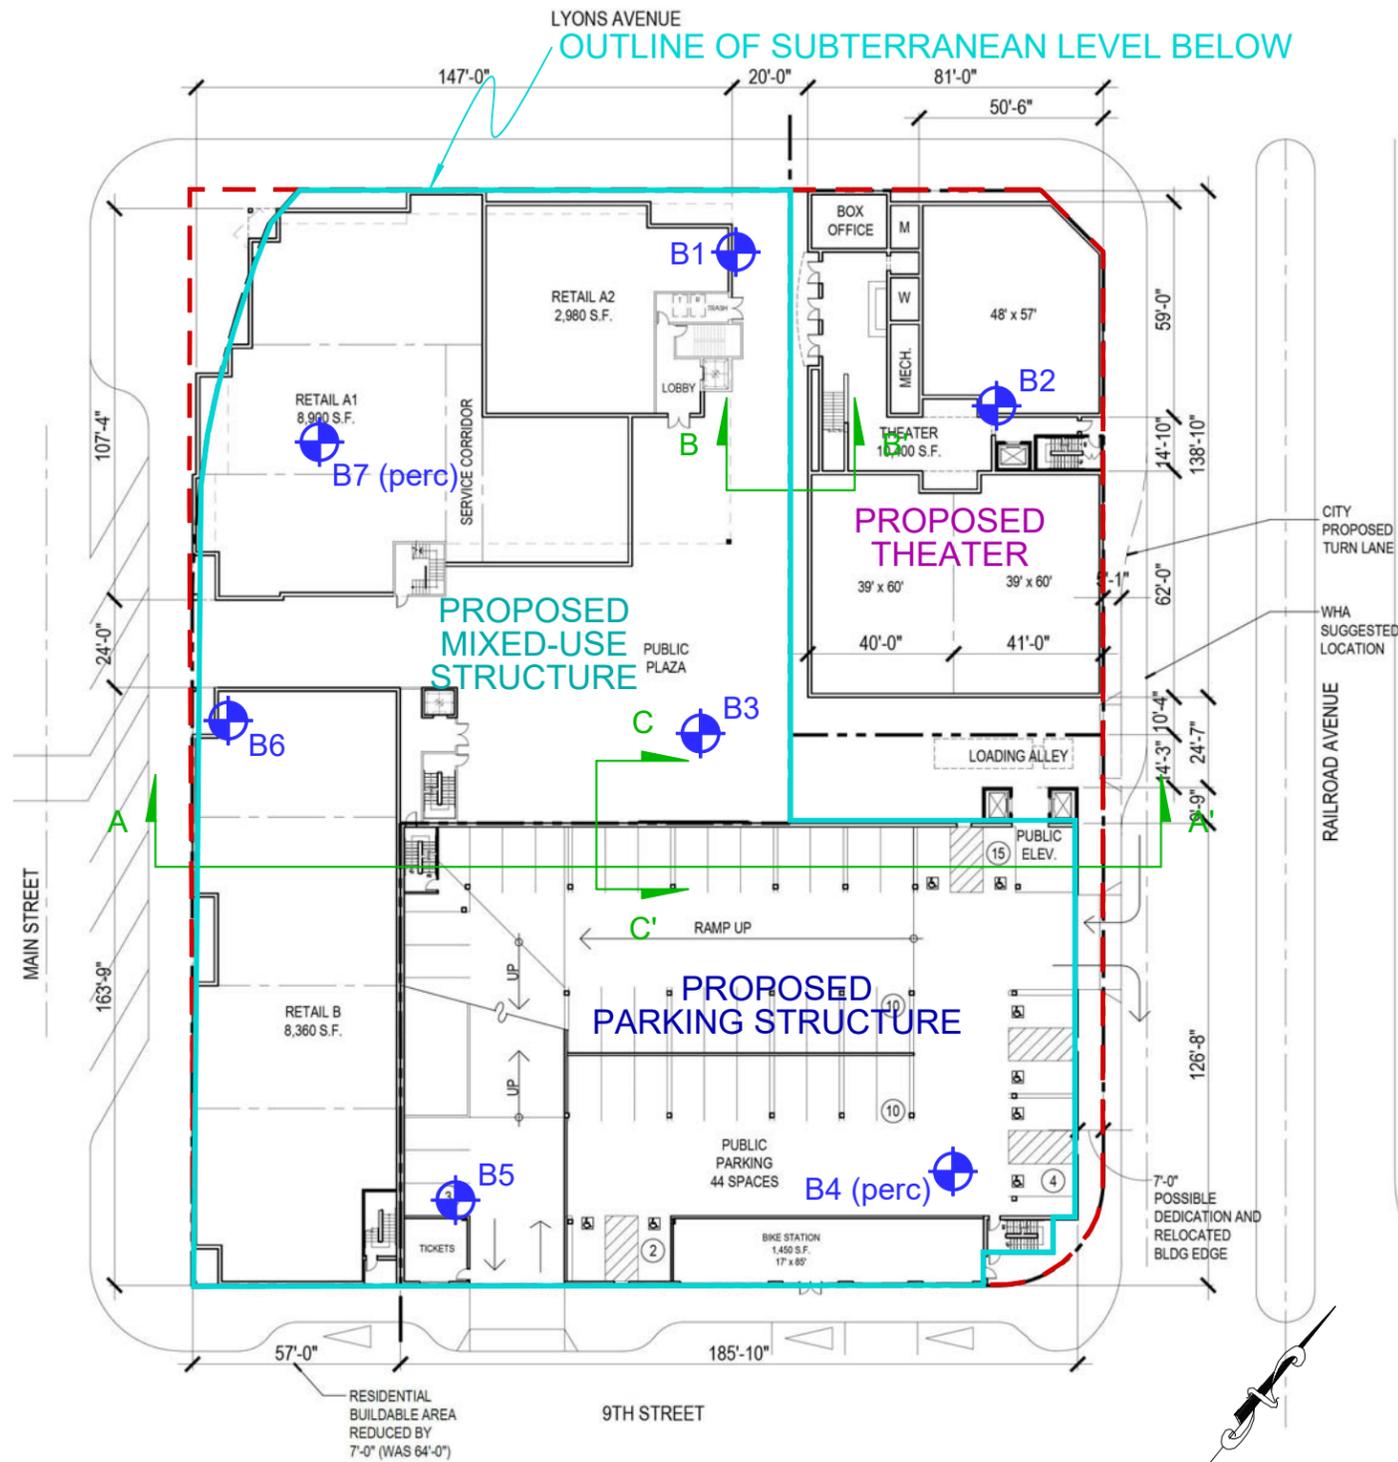


LEGEND

B7 Approximate Location of Boring

Approximate Limits of Proposed Development

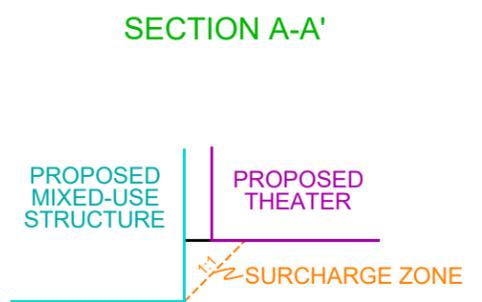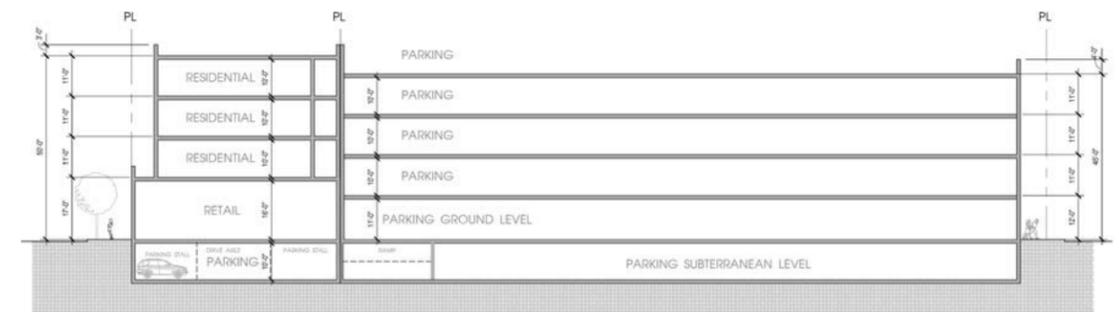

FOR ILLUSTRATION PURPOSES ONLY. NOT FOR CONSTRUCTION. No Scale

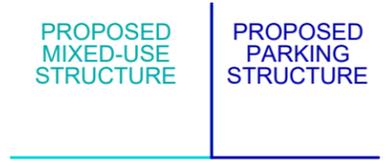

FOR ILLUSTRATION PURPOSES ONLY. NOT FOR CONSTRUCTION. No Scale

GEOCON WEST, INC.

ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704


DRAFTED BY: PZ CHECKED BY: JMT

SITE PLAN

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA


NOV. 10, 2015 PROJECT NO. A9332-06-01 FIG. 2

Reference: Jennings, C.W. and Bryant, W. A., 2010, Fault Activity Map of California, California Geological Survey Geologic Data Map No. 6.

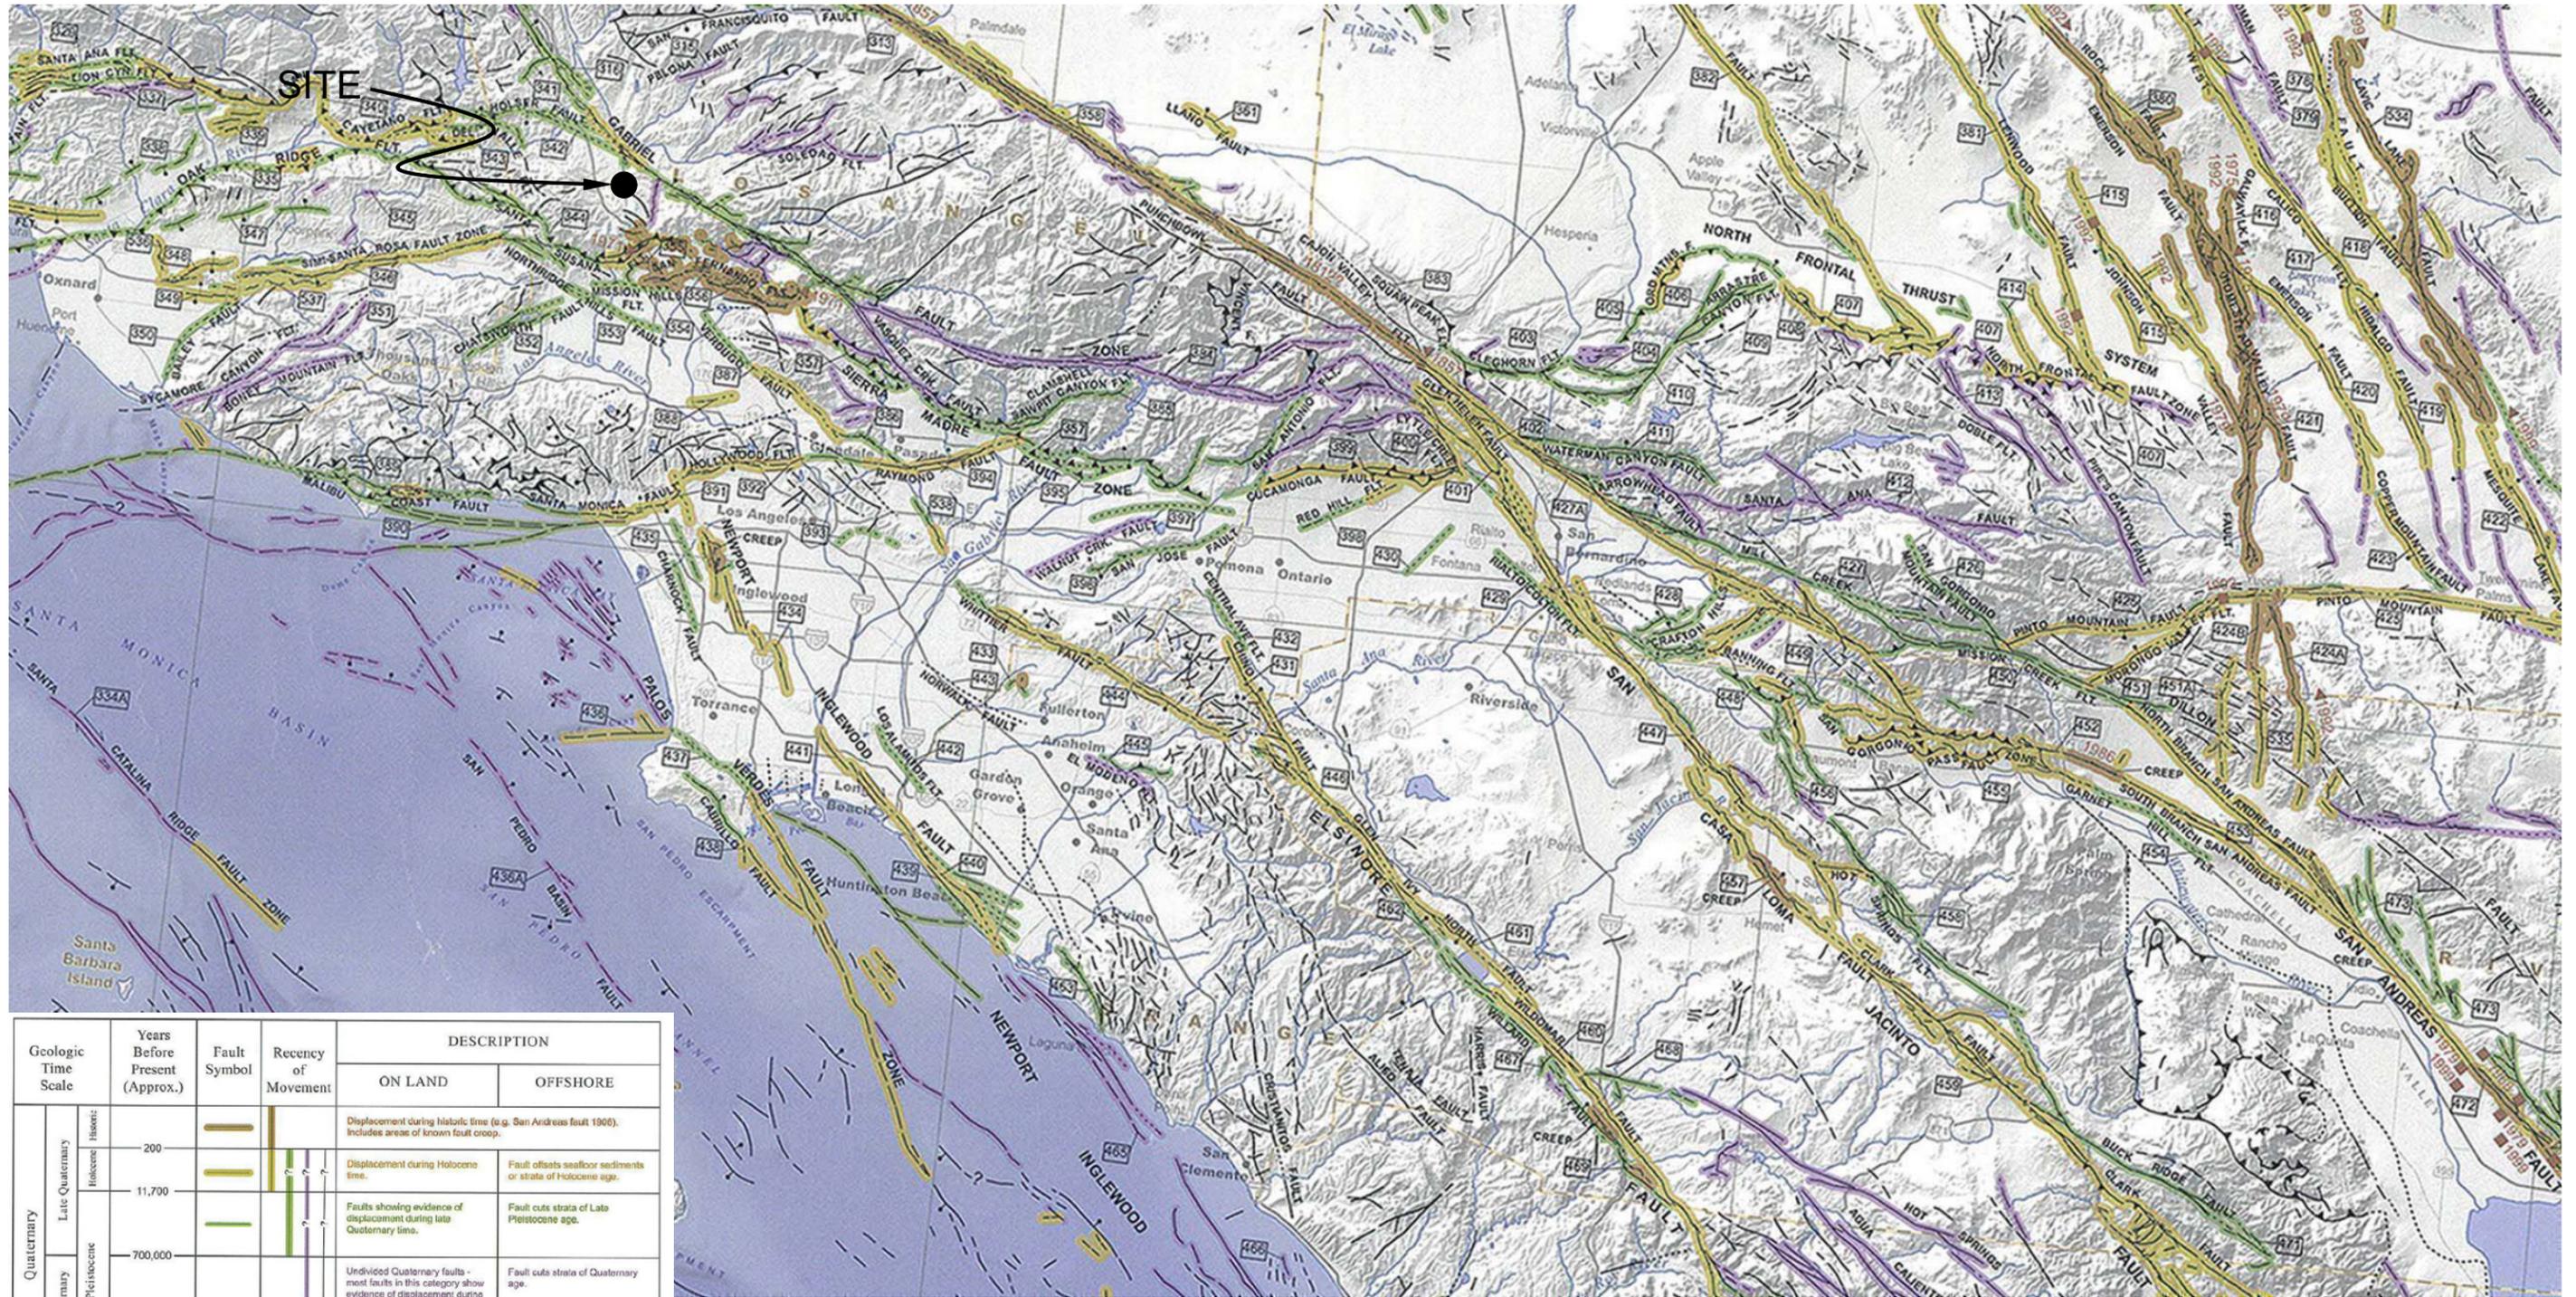

Geologic Time Scale	Years Before Present (Approx.)	Fault Symbol	Recency of Movement	DESCRIPTION	
				ON LAND	OFFSHORE
Quaternary	Holocene			Displacement during historic time (e.g. San Andreas fault 1906). Includes areas of known fault creep.	Fault offsets seafloor sediments or strata of Holocene age.
	Late Quaternary			Displacement during Holocene time.	Fault cuts strata of Late Pleistocene age.
Pre-Quaternary	Pleistocene			Faults showing evidence of displacement during late Quaternary time.	Fault cuts strata of Quaternary age.
	4.5 billion (Age of Earth)			Undiscovered Quaternary faults - most faults in this category show evidence of displacement during the last 1,600,000 years; possible exceptions are faults which displace rocks of undifferentiated Plio-Pleistocene age.	Fault cuts strata of Pliocene or older age.

* Quaternary now recognized as extending to 2.6 Ma (Walker and Geissman, 2009). Quaternary faults in this map were established using the previous 1.6 Ma criterion.

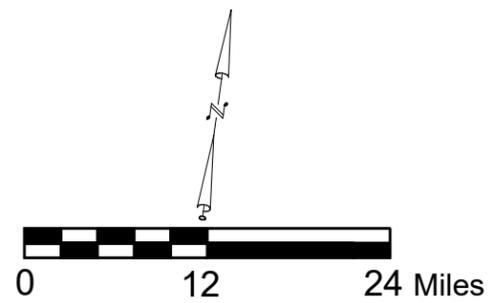

GEOCON WEST, INC.


ENVIRONMENTAL GEOTECHNICAL MATERIALS
 3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
 PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: RA CHECKED BY: SFK

REGIONAL FAULT MAP

OLD TOWN-MAIN, LLC
 C/O SERRANO DEVELOPMENT GROUP, INC.
 MAIN STREET & 9TH STREET
 SANTA CLARITA, CALIFORNIA


NOV. 10, 2015 PROJECT NO. A9332-06-01 FIG. 3

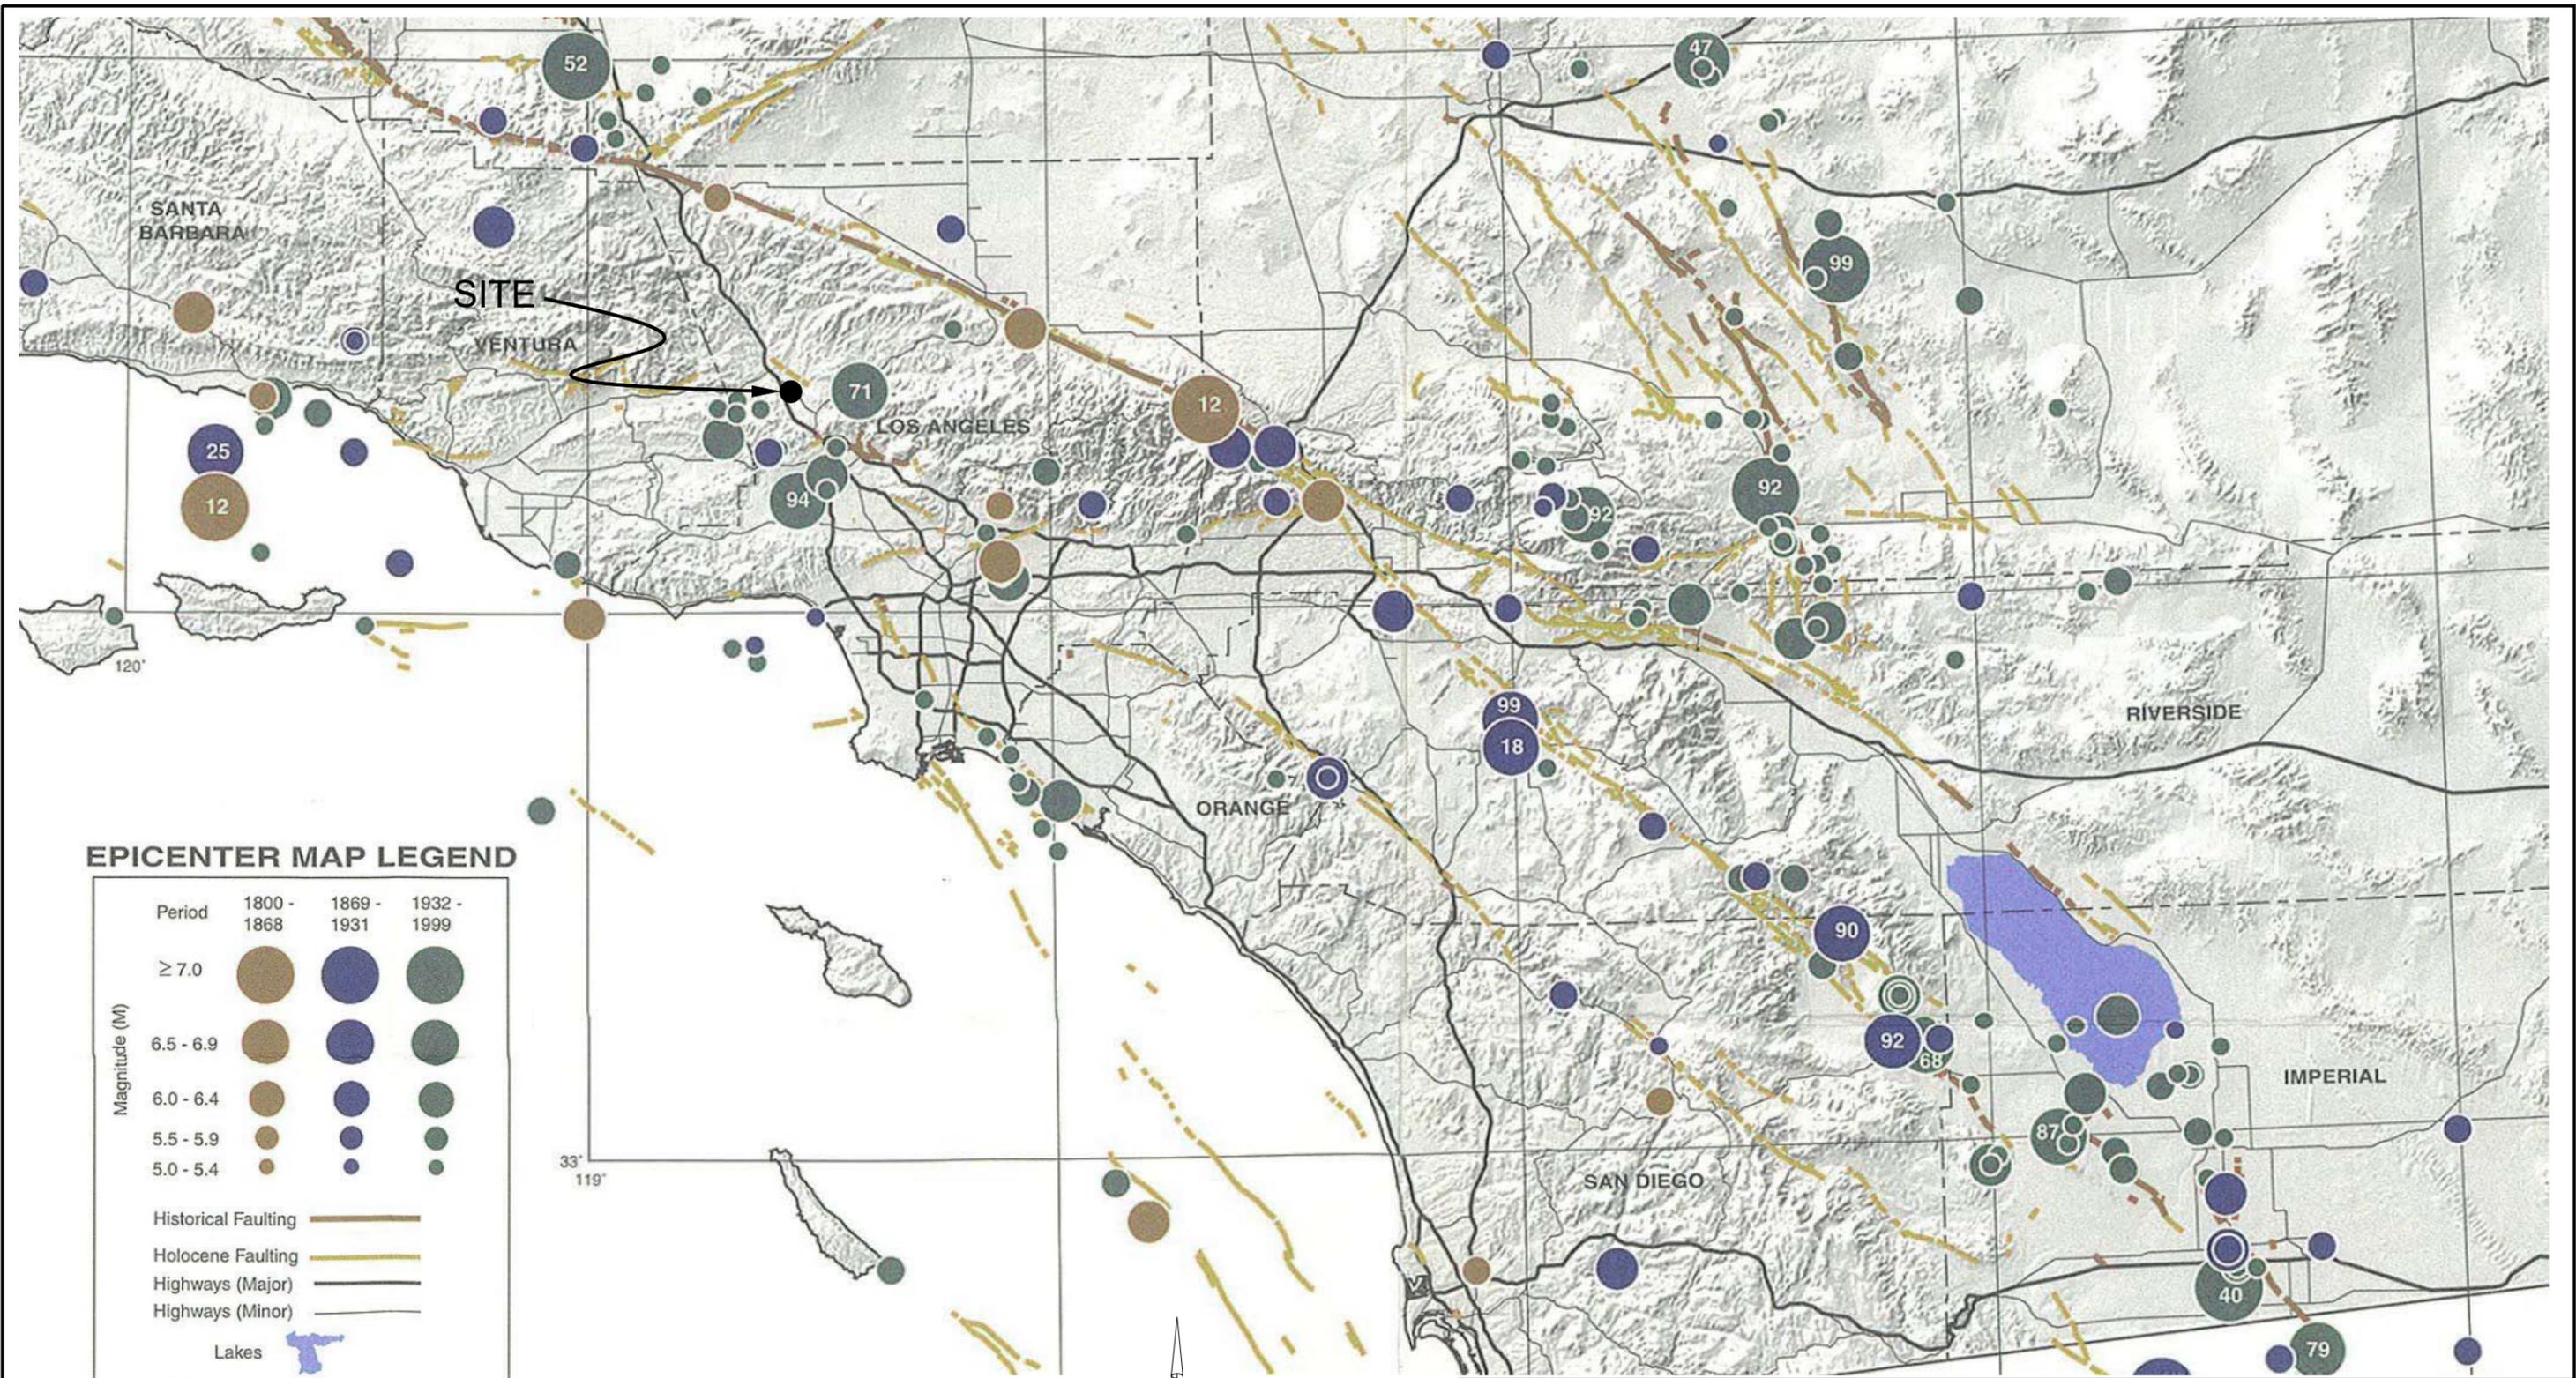

EPICENTER MAP LEGEND

Period	1800 - 1868	1869 - 1931	1932 - 1999
Magnitude (M) ≥ 7.0			
6.5 - 6.9			
6.0 - 6.4			
5.5 - 5.9			
5.0 - 5.4			
Historical Faulting			
Holocene Faulting			
Highways (Major)			
Highways (Minor)			
Lakes			
	Last two digits of M ≥ 6.5 earthquake year		

Reference: Topozada, T., Branum, D., Petersen, M., Hallstrom, C., Cramer, C., and Reichle, M., 2000, Epicenters and Areas Damaged by M≥5 California Earthquakes, 1800 - 1999, California Geological Survey, Map Sheet 49.

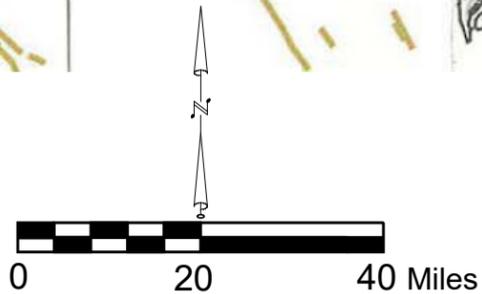

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: RA

CHECKED BY: SFK


REGIONAL SEISMICITY MAP

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC.
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. 4

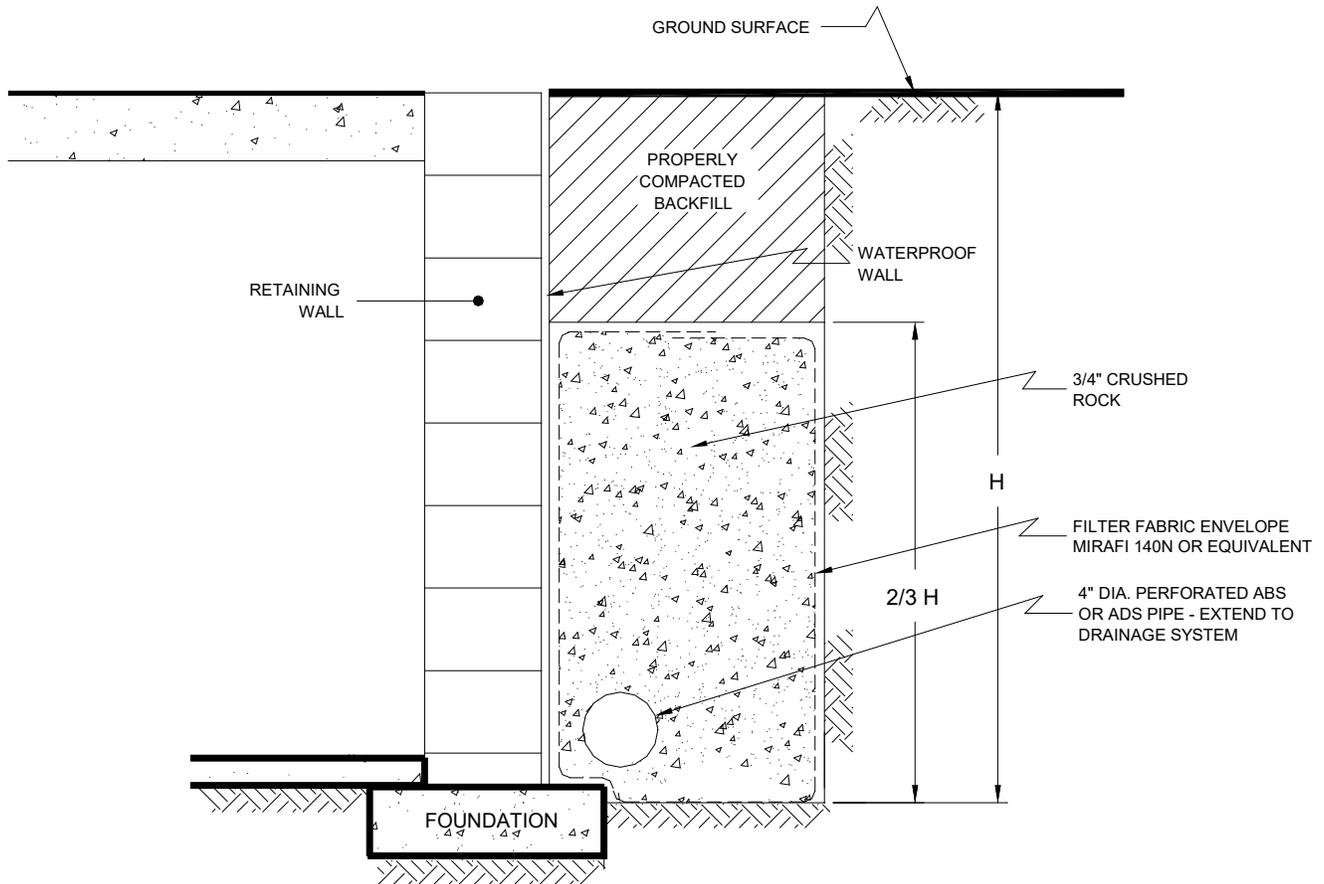

NO SCALE

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT


RETAINING WALL DRAIN DETAIL

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. 5

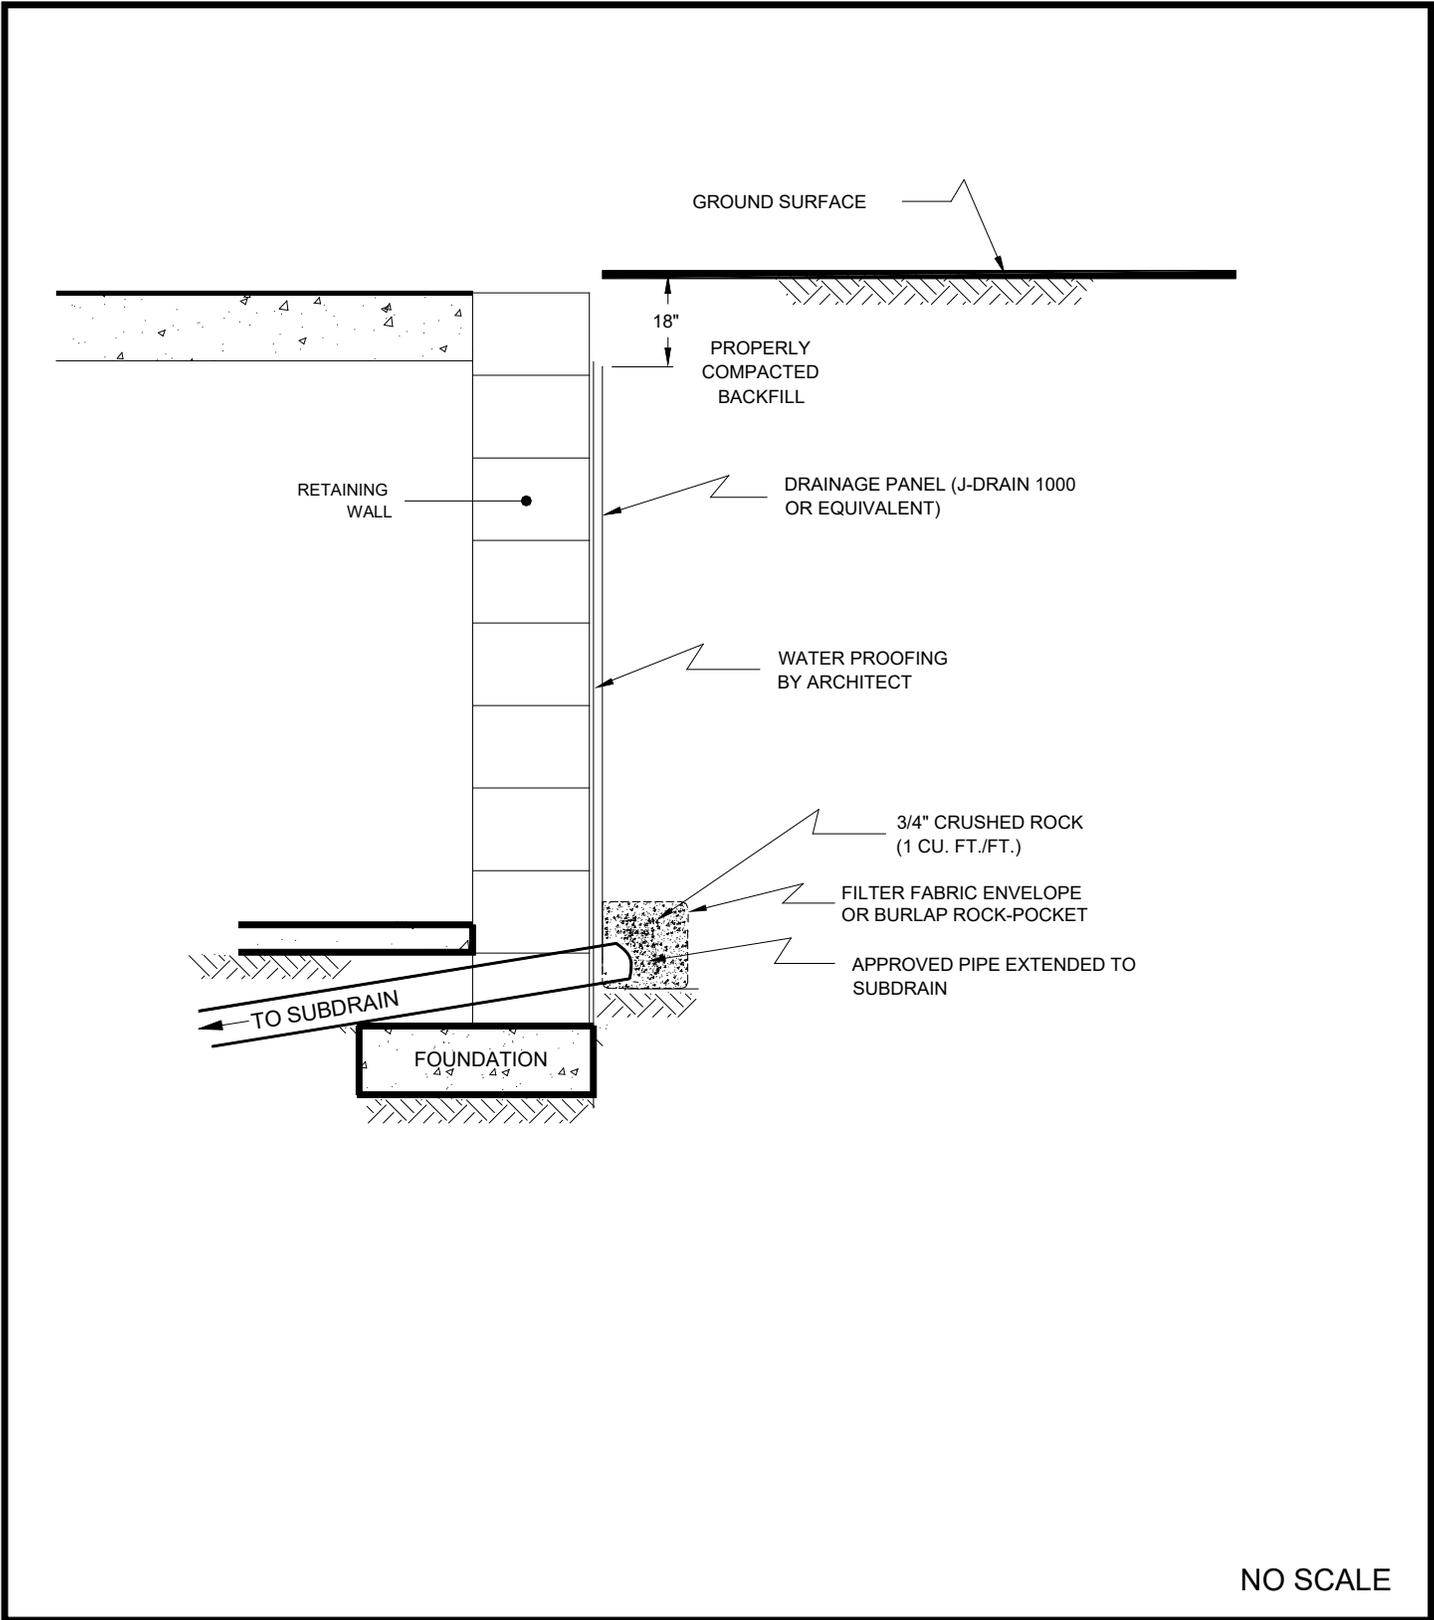

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ CHECKED BY: JMT


RETAINING WALL DRAIN DETAIL

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015 PROJECT NO. A9332-06-01 FIG. 6

APPENDIX

A



APPENDIX A

FIELD INVESTIGATION

The site was explored on October 5, 2015 by excavating seven 8-inch-diameter borings utilizing a truck-mounted hollow-stem auger drilling machine. The borings were excavated to a maximum depth of approximately 30½ feet below the existing ground surface. Representative and relatively undisturbed samples were obtained by driving a 3 inch, O. D., California Modified Sampler into the “undisturbed” soil mass with blows from a 140-pound auto-hammer falling 30 inches. The California Modified Sampler was equipped with 1-inch high by 2³/₈-inch diameter brass sampler rings to facilitate soil removal and testing. Bulk samples were also obtained.

The soil conditions encountered in the borings were visually examined, classified and logged in general accordance with the Unified Soil Classification System (USCS). Logs of the borings are presented on Figures A1 through A7. The logs depict the soil and geologic conditions encountered and the depth at which samples were obtained.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 1		PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
					ELEV. (MSL.) _____ DATE COMPLETED <u>10/5/15</u>	EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>			
MATERIAL DESCRIPTION									
0						AC: 3.5" BASE: NONE ARTIFICIAL FILL Silty Sand, medium dense, slightly moist, brown, fine- to medium-grained.			
2	B1@2.5'					ALLUVIUM Sand with Silt, medium dense, slightly moist, light brown, fine- to coarse-grained. - fine- to medium-grained	21	107.4	3.1
4						- loose, fine- to coarse-grained			
6	B1@6'			SP-SM			15	106.1	3.6
8									
10	B1@10'						19	108.0	3.8
12	B1@12'			SM		Silty Sand, loose, slightly moist, brown, fine-grained, some medium-grained.	12	106.1	10.5
14									
16	B1@15'					Sand with Silt, medium dense, slightly moist, light brown, fine- to coarse-grained, some fine gravel.	31	115.9	2.4
18	B1@18'			SP-SM		- fine- to medium-grained	19	106.5	2.7
20	B1@20'			SM		Silty Sand, loose, slightly moist, brown, fine-grained, trace medium-grained.	16	99.6	4.7
22						Sand with Silt, medium dense, slightly moist, light brown, fine- to medium-grained, trace coarse-grained.			
24									
26	B1@25'			SP-SM			46	117.1	2.2
28				SM		Silty Sand, medium dense, slightly moist, brown, fine-grained.			

Figure A1,
Log of Boring 1, Page 1 of 2

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS	 ... SAMPLING UNSUCCESSFUL	 ... STANDARD PENETRATION TEST	 ... DRIVE SAMPLE (UNDISTURBED)
	 ... DISTURBED OR BAG SAMPLE	 ... CHUNK SAMPLE	 ... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 1		PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)	
					ELEV. (MSL.) _____	DATE COMPLETED <u>10/5/15</u>				
					EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>					
					MATERIAL DESCRIPTION					
30	B1@30'			SM	Total depth of boring: 30.5 feet Fill to 2 feet. No groundwater encountered. Backfilled with soil cuttings and tamped. Asphalt patched. *Penetration resistance for 140-pound hammer falling 30 inches by auto hammer.		30	103.4	21.2	

**Figure A1,
Log of Boring 1, Page 2 of 2**

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS	<input type="checkbox"/> ... SAMPLING UNSUCCESSFUL	<input type="checkbox"/> ... STANDARD PENETRATION TEST	<input checked="" type="checkbox"/> ... DRIVE SAMPLE (UNDISTURBED)
	<input checked="" type="checkbox"/> ... DISTURBED OR BAG SAMPLE	<input checked="" type="checkbox"/> ... CHUNK SAMPLE	<input checked="" type="checkbox"/> ... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 2		PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
					ELEV. (MSL.) _____ DATE COMPLETED <u>10/5/15</u>	EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>			
MATERIAL DESCRIPTION									
0						GRAVEL ARTIFICIAL FILL			
2						Silty Sand, loose, slightly moist, brown, fine- to medium-grained.			
2.5	B2@2.5'					ALLUVIUM	19	109.2	3.8
4						Sand with Silt, medium dense, slightly moist, light brown, fine- to medium-grained.			
6	B2@6'					- fine- to coarse-grained	24	117.1	3.4
10	B2@10' BULK 10-15'			SP-SM			27	104.6	4.1
12	B2@12'						29	109.6	3.0
15	B2@15'						28	--	--
18	B2@18'					- some fine gravel	35	110.9	4.3
20	B2@20'						15	113.6	3.2
22				SM		Silty Sand, loose, slightly moist, brown, fine-grained, trace medium-grained.			
24						Sand with Silt, medium dense, slightly moist, light brown, fine- to coarse-grained, trace fine gravel.			
25	B2@25'			SP-SM			51	114.1	3.1
28									

Figure A2,
Log of Boring 2, Page 1 of 2

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS	 ... SAMPLING UNSUCCESSFUL	 ... STANDARD PENETRATION TEST	 ... DRIVE SAMPLE (UNDISTURBED)
	 ... DISTURBED OR BAG SAMPLE	 ... CHUNK SAMPLE	 ... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 2			PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
					ELEV. (MSL.) _____	DATE COMPLETED <u>10/5/15</u>	EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>			
MATERIAL DESCRIPTION										
30	B2@30'			SP-SM	Total depth of boring: 30.5 feet Fill to 1.5 feet. No groundwater encountered. Backfilled with soil cuttings and tamped. Surface restored. *Penetration resistance for 140-pound hammer falling 30 inches by auto hammer.			76	115.9	3.1

**Figure A2,
Log of Boring 2, Page 2 of 2**

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS	<input type="checkbox"/>	... SAMPLING UNSUCCESSFUL	<input type="checkbox"/>	... STANDARD PENETRATION TEST	<input checked="" type="checkbox"/>	... DRIVE SAMPLE (UNDISTURBED)
	<input checked="" type="checkbox"/>	... DISTURBED OR BAG SAMPLE	<input checked="" type="checkbox"/>	... CHUNK SAMPLE	<input checked="" type="checkbox"/>	... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 3		PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
					ELEV. (MSL.) _____ DATE COMPLETED <u>10/5/15</u>	EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>			
MATERIAL DESCRIPTION									
0	BULK 0-5'					AC: 2" BASE: 2.5" ARTIFICIAL FILL Silty Sand, medium dense, slightly moist, brown, fine-grained, some fine gravel.			
2	B3@2.5'					ALLUVIUM Sand with Silt, medium dense, slightly moist, light brown, fine- to medium-grained.	22	115.4	3.8
4	B3@5'					- loose, fine- to coarse-grained, trace fine to coarse gravel	14	104.0	2.5
6	B3@7'					- medium dense, increase in gravel content	21	93.3	3.1
8	B3@10'			SP-SM		- increase in coarse gravel (to 2"), cobbles from 10-11 feet (4-5")	50 (3")	85.8	4.0
10	B3@12'						23	109.4	3.0
12	B3@15'						24	110.5	3.2
14	B3@20'			SM		- fine-grained Silty Sand, medium dense, slightly moist, brown, fine-grained, trace medium- to coarse-grained.	18	112.1	13.0
Total depth of boring: 20.5 feet Fill to 2 feet. No groundwater encountered. Backfilled with soil cuttings and tamped. Asphalt patched. *Penetration resistance for 140-pound hammer falling 30 inches by auto hammer.									

Figure A3,
Log of Boring 3, Page 1 of 1

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS		
	... SAMPLING UNSUCCESSFUL	
	... DISTURBED OR BAG SAMPLE	
		
		... DRIVE SAMPLE (UNDISTURBED)
		... CHUNK SAMPLE
		... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 4		PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
					ELEV. (MSL.) _____ DATE COMPLETED <u>10/5/15</u>	EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>			
MATERIAL DESCRIPTION									
0						AC: 0.5" BASE: 12" ARTIFICIAL FILL Silty Sand, loose, slightly moist, brown, fine-grained.			
2	B4@2.5'					ALLUVIUM Sand with Silt, medium dense, slightly moist, light brown, fine- to coarse-grained.	18	116.3	2.9
4									
6	B4@6'			SP-SM		- some fine gravel	30	110.0	3.2
8									
10	B4@10'					- increase in gravel content			
10	BULK 10-15'			SM		Silty Sand, medium dense, slightly moist, brown, fine-grained, trace medium-grained.	20	82.8	2.9
12	B4@12'					- decrease in silt content, fine- to medium-grained, trace fine gravel			
12						Sand with Silt, medium dense, slightly moist, light brown, fine- to medium-grained, some coarse-grained, trace fine gravel.	24	102.8	3.5
14									
16	B4@15'			SP-SM		- increase in silt content	24	108.2	5.9
18	B4@18'					- decrease in silt content			
20	B4@20'			SM		Silty Sand, medium dense, slightly moist, brown, fine-grained, some medium- to coarse-grained.	22	--	--
22									
24						Sand with Silt, medium dense, slightly moist, light brown, fine- to medium-grained, trace coarse-grained.			
26	B4@25'			SP-SM			48	118.7	2.0
28									
						Silty Sand, medium dense, slightly moist, brown, fine-grained, trace			

Figure A4,
Log of Boring 4, Page 1 of 2

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS	 ... SAMPLING UNSUCCESSFUL	 ... STANDARD PENETRATION TEST	 ... DRIVE SAMPLE (UNDISTURBED)
	 ... DISTURBED OR BAG SAMPLE	 ... CHUNK SAMPLE	 ... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 4 ELEV. (MSL.) _____ DATE COMPLETED <u>10/5/15</u> EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>	PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
30	B4@30'			SM	MATERIAL DESCRIPTION medium-grained, trace coarse gravel. Total depth of boring: 30.5 feet Fill to 2 feet. No groundwater encountered. Backfilled with soil cuttings and tamped. *Penetration resistance for 140-pound hammer falling 30 inches by auto hammer.	39	112.9	14.7

**Figure A4,
Log of Boring 4, Page 2 of 2**

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS <input type="checkbox"/> ... SAMPLING UNSUCCESSFUL <input checked="" type="checkbox"/> ... DISTURBED OR BAG SAMPLE	<input type="checkbox"/> ... STANDARD PENETRATION TEST <input checked="" type="checkbox"/> ... CHUNK SAMPLE	<input checked="" type="checkbox"/> ... DRIVE SAMPLE (UNDISTURBED) <input checked="" type="checkbox"/> ... WATER TABLE OR SEEPAGE
---	--	--

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 5			PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
					ELEV. (MSL.) _____	DATE COMPLETED <u>10/5/15</u>				
					EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>					
					MATERIAL DESCRIPTION					
0	BULK 0-5'				AC: 6" BASE: 4" ARTIFICIAL FILL Silty Sand, loose, slightly moist, brown, fine- to medium-grained, trace coarse-grained, some asphalt fragments.					
2	B5@2.5'				- asphalt layer (1/2")			10	--	--
4	B5@5'				ALLUVIUM Silty Sand, loose, slightly moist, brown, fine- to medium-grained, trace coarse-grained, trace rootlets.			10	111.4	5.7
6	B5@7'			SM	- increase in medium- to coarse-grained, trace fine gravel			12	111.5	5.5
8	B5@10'			SM	- decrease in silt content, medium dense			24	110.2	7.6
10	B5@15'			SP-SM	Sand with Silt, medium dense, slightly moist, light brown, fine- to coarse-grained, trace fine gravel.			23	111.9	1.8
12	B5@20'			SM	Silty Sand, loose, slightly moist, brown, fine-grained, trace medium-grained,			17	99.9	1.2
14					Total depth of boring: 20.5 feet Fill to 5 feet. No groundwater encountered. Backfilled with soil cuttings and tamped.					
16					*Penetration resistance for 140-pound hammer falling 30 inches by auto hammer.					

**Figure A5,
Log of Boring 5, Page 1 of 1**

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS	<input type="checkbox"/> ... SAMPLING UNSUCCESSFUL	<input type="checkbox"/> ... STANDARD PENETRATION TEST	<input checked="" type="checkbox"/> ... DRIVE SAMPLE (UNDISTURBED)
	<input checked="" type="checkbox"/> ... DISTURBED OR BAG SAMPLE	<input checked="" type="checkbox"/> ... CHUNK SAMPLE	<input checked="" type="checkbox"/> ... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 6		PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
					ELEV. (MSL.) _____ DATE COMPLETED <u>10/5/15</u>	EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>			
MATERIAL DESCRIPTION									
0						AC: 1" BASE: NONE			
2						ARTIFICIAL FILL Sand with Silt, loose, slightly moist, light brown, fine- to medium-grained, trace coarse-grained.			
B6@2.5'							8	102.8	3.9
4						ALLUVIUM Silty Sand, loose, slightly moist, brown, fine- to medium-grained.			
B6@6'						- some coarse-grained	14	115.6	5.4
8				SM					
10						- increase in silt content, fine-grained	11	102.0	10.6
B6@10' BULK 10-15'									
B6@12'						- trace medium- to coarse-grained	12	108.8	13.0
14						- decrease in silt content			
B6@15'						Sand with Silt, medium dense, slightly moist, light brown, fine- to medium-grained, trace coarse-grained, trace fine gravel.	21	112.0	6.7
18				SP-SM					
B6@18'						- increase in gravel content	34	109.0	3.1
20							17	107.9	2.2
B6@20'						Silty Sand, medium dense, slightly moist, brown, fine-grained, some medium-grained.			
22									
24				SM					
B6@25'						- decrease in silt content	18	109.8	11.5
26									
28									

Figure A6,
Log of Boring 6, Page 1 of 2

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS	 ... SAMPLING UNSUCCESSFUL	 ... STANDARD PENETRATION TEST	 ... DRIVE SAMPLE (UNDISTURBED)
	 ... DISTURBED OR BAG SAMPLE	 ... CHUNK SAMPLE	 ... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 6 ELEV. (MSL.) _____ DATE COMPLETED <u>10/5/15</u> EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>	PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
30	B6@30'			SM	MATERIAL DESCRIPTION - decrease in silt content, trace coarse-grained Total depth of boring: 30.5 feet Fill to 2.5 feet. No groundwater encountered. Backfilled with soil cuttings and tamped. Asphalt patched. *Penetration resistance for 140-pound hammer falling 30 inches by auto hammer.	20	117.5	10.4

**Figure A6,
Log of Boring 6, Page 2 of 2**

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS <input type="checkbox"/> ... SAMPLING UNSUCCESSFUL <input checked="" type="checkbox"/> ... DISTURBED OR BAG SAMPLE	<input type="checkbox"/> ... STANDARD PENETRATION TEST <input checked="" type="checkbox"/> ... CHUNK SAMPLE	<input checked="" type="checkbox"/> ... DRIVE SAMPLE (UNDISTURBED) <input checked="" type="checkbox"/> ... WATER TABLE OR SEEPAGE
---	--	--

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.

DEPTH IN FEET	SAMPLE NO.	LITHOLOGY	GROUNDWATER	SOIL CLASS (USCS)	BORING 7		PENETRATION RESISTANCE (BLOWS/FT*)	DRY DENSITY (P.C.F.)	MOISTURE CONTENT (%)
					ELEV. (MSL.) _____ DATE COMPLETED <u>10/5/15</u>	EQUIPMENT <u>HOLLOW STEM AUGER</u> BY: <u>PZ</u>			
MATERIAL DESCRIPTION									
0	BULK 0-5'					AC: 2" BASE: 4" ARTIFICIAL FILL Silty Sand, medium dense, slightly moist, brown, fine- to medium-grained, some fine gravel.			
2	B7@2.5'			SP-SM		ALLUVIUM Sand with Silt, loose, slightly moist, light brown, fine- to medium-grained, some coarse-grained, some fine gravel.	11	101.7	3.6
4									
6	B7@5'					Silty Sand, very loose, slightly moist, brown, fine-grained, some medium-grained.	7	107.2	7.6
8									
10	B7@10'			SM		- decrease in silt content, loose	10	101.6	8.0
12	B7@12'					- increase in silt content	10	109.6	14.5
14									
16	B7@15'					- decrease in silt content, medium dense, fine- to coarse-grained	23	117.3	10.2
18	B7@18'			SP-SM		Sand with Silt, medium dense, slightly moist, light brown, fine- to medium-grained, some coarse-grained.	29	138.9	3.0
20	B7@20'					- trace fine gravel	22	128.4	3.1
Total depth of boring: 20.5 feet Fill to 2 feet. No groundwater encountered. Backfilled with soil cuttings and tamped. Asphalt patched. *Penetration resistance for 140-pound hammer falling 30 inches by auto hammer.									


Figure A7,
Log of Boring 7, Page 1 of 1

A9332-06-01 BORING LOGS.GPJ

SAMPLE SYMBOLS	 ... SAMPLING UNSUCCESSFUL	 ... STANDARD PENETRATION TEST	 ... DRIVE SAMPLE (UNDISTURBED)
	 ... DISTURBED OR BAG SAMPLE	 ... CHUNK SAMPLE	 ... WATER TABLE OR SEEPAGE

NOTE: THE LOG OF SUBSURFACE CONDITIONS SHOWN HEREON APPLIES ONLY AT THE SPECIFIC BORING OR TRENCH LOCATION AND AT THE DATE INDICATED. IT IS NOT WARRANTED TO BE REPRESENTATIVE OF SUBSURFACE CONDITIONS AT OTHER LOCATIONS AND TIMES.


APPENDIX



APPENDIX B

LABORATORY TESTING

Laboratory tests were performed in accordance with generally accepted test methods of the “American Society for Testing and Materials (ASTM)”, or other suggested procedures. Selected samples were tested for direct shear strength, consolidation and expansion characteristics, corrosivity, in-place dry density and moisture content. The results of the laboratory tests are summarized in Figures B1 through B10. The in-place dry density and moisture content of the samples tested are presented on the boring logs, Appendix A.

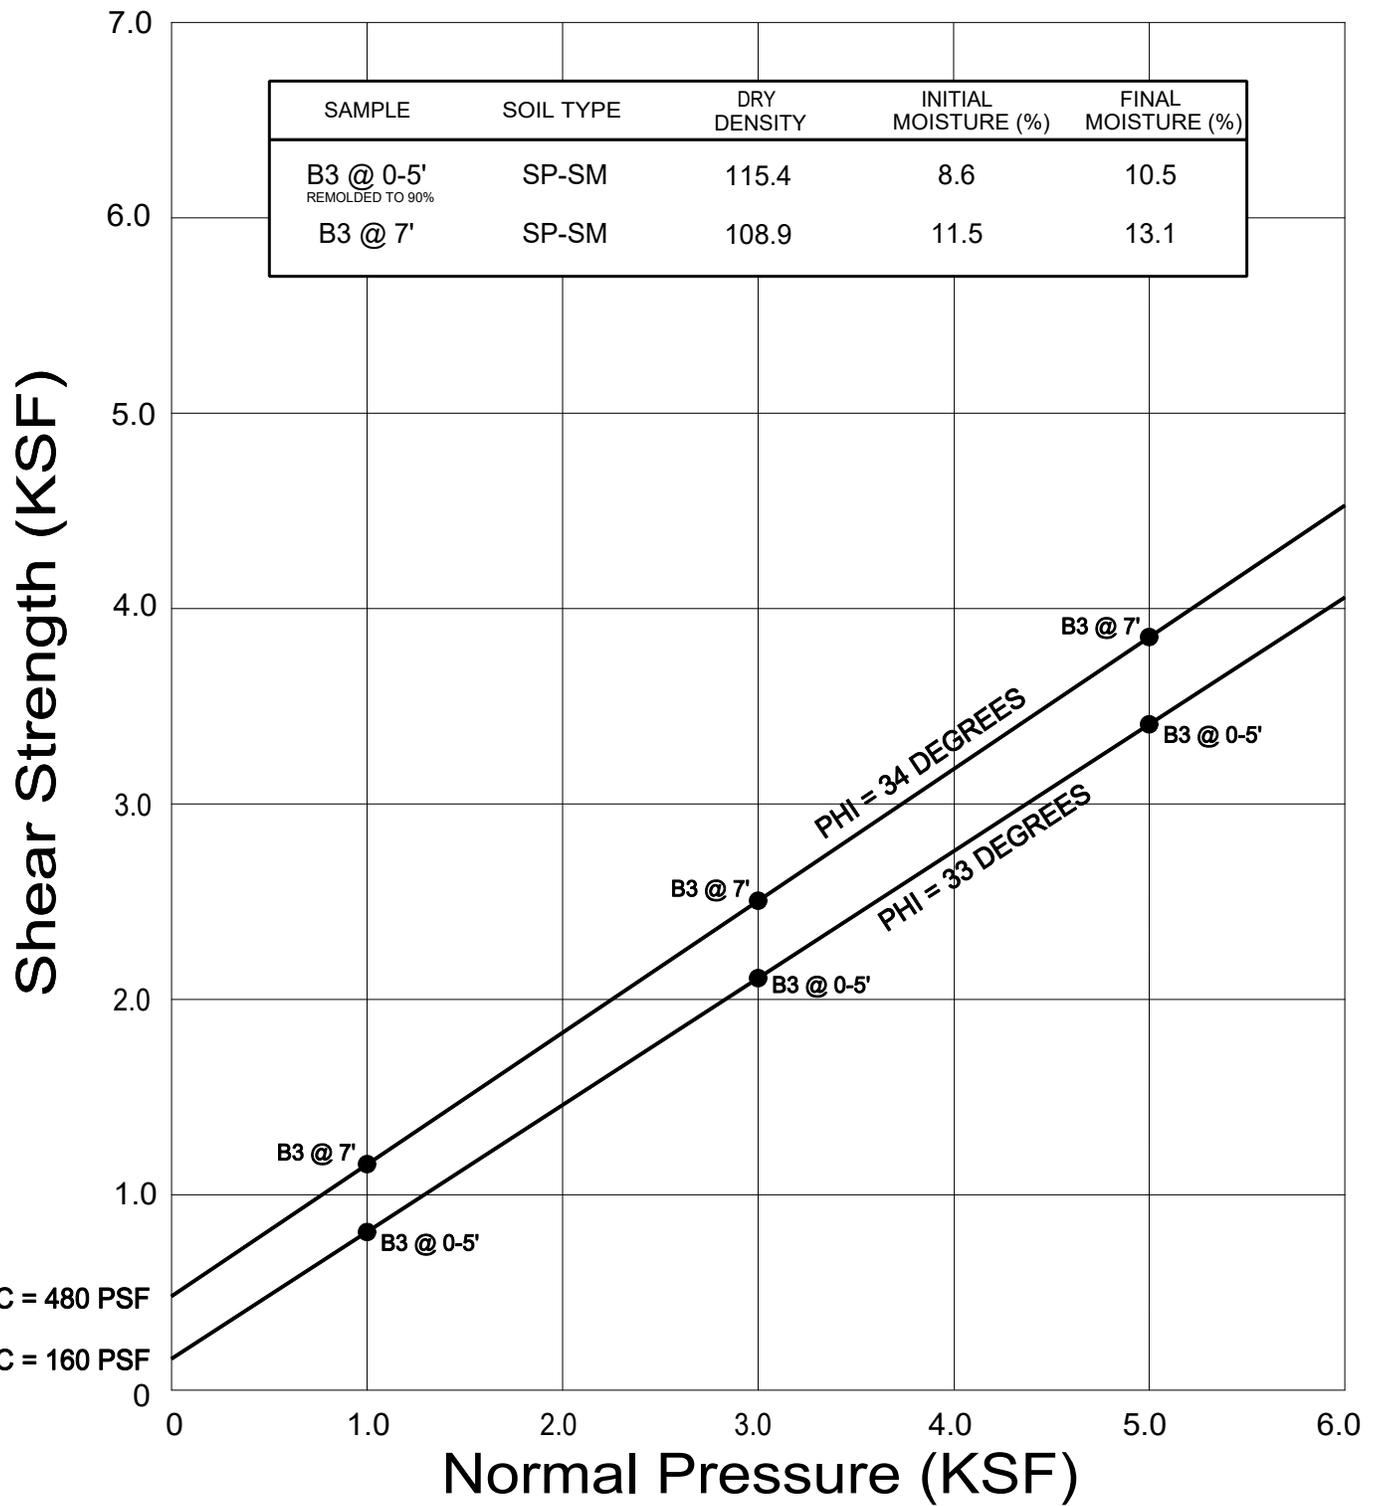

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT


DIRECT SHEAR TEST RESULTS

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B1

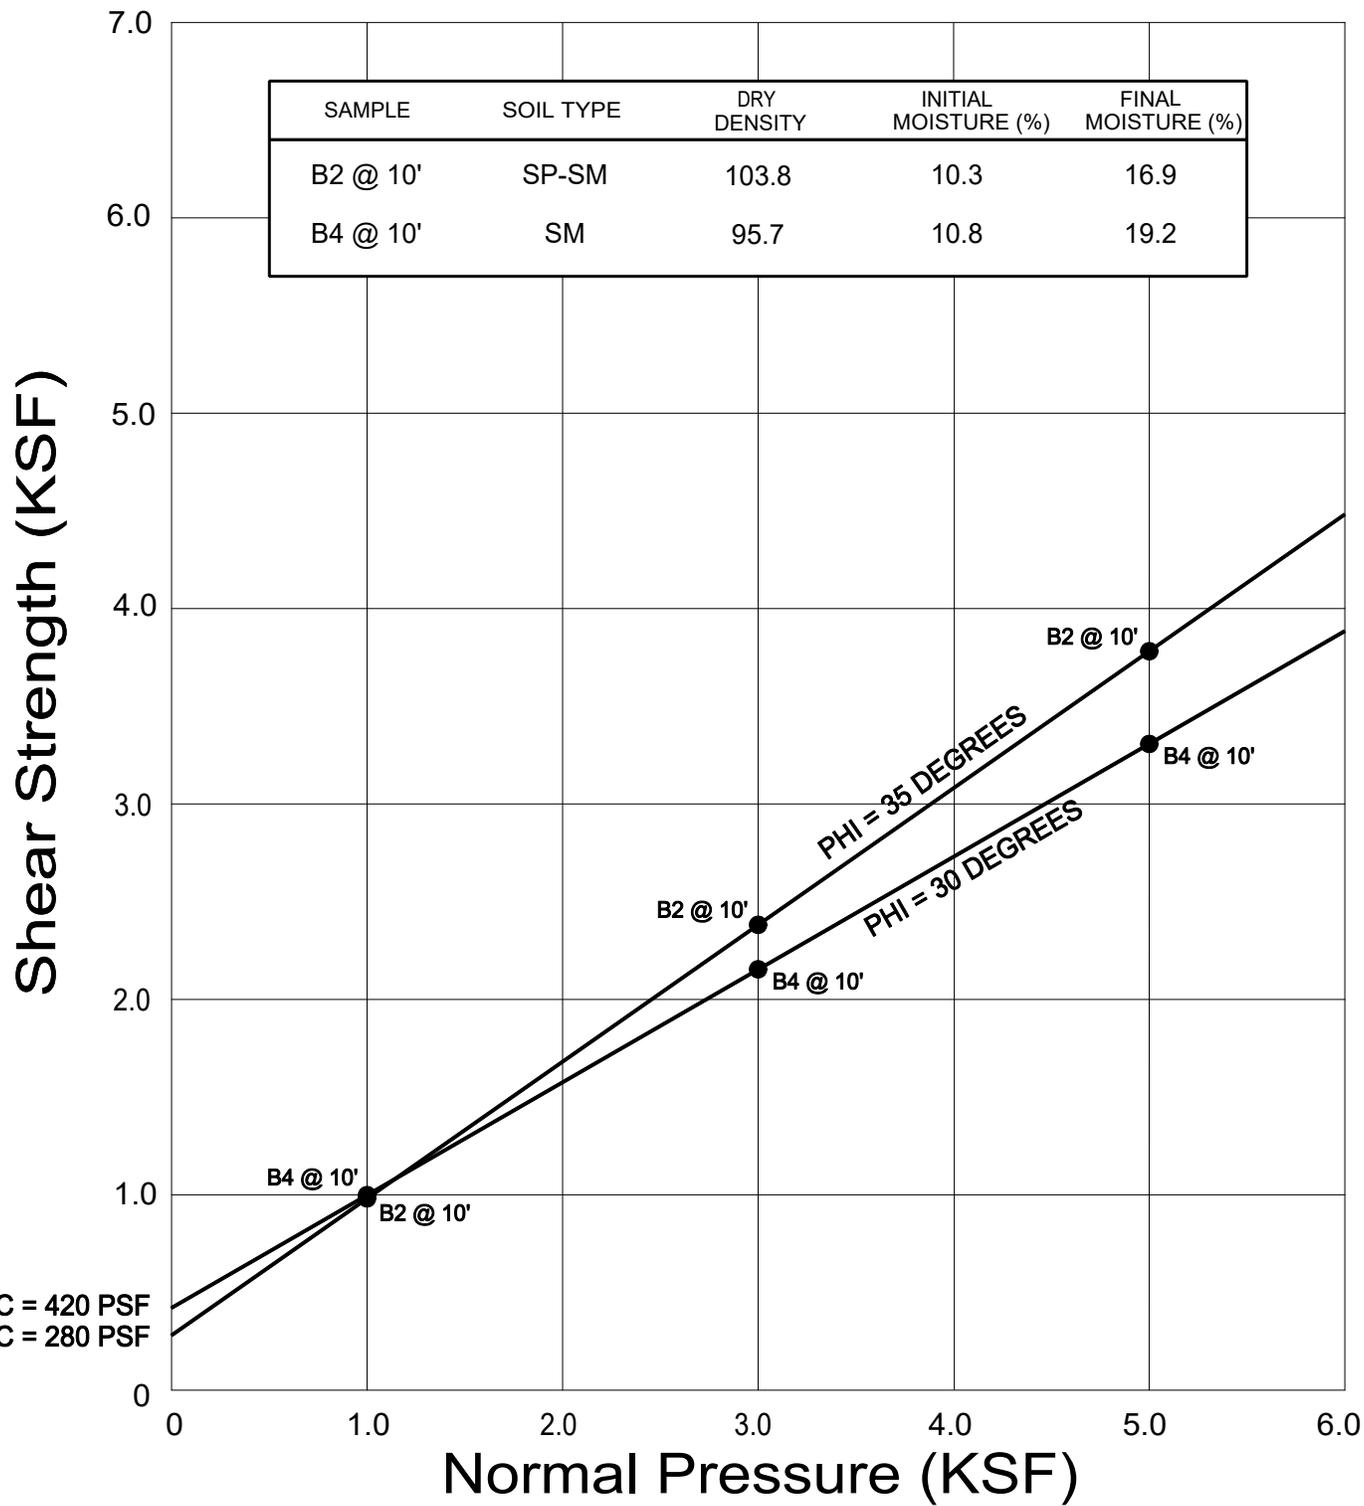

● Direct Shear, Saturated

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DIRECT SHEAR TEST RESULTS

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA


DRAFTED BY: PZ

CHECKED BY: JMT

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B2

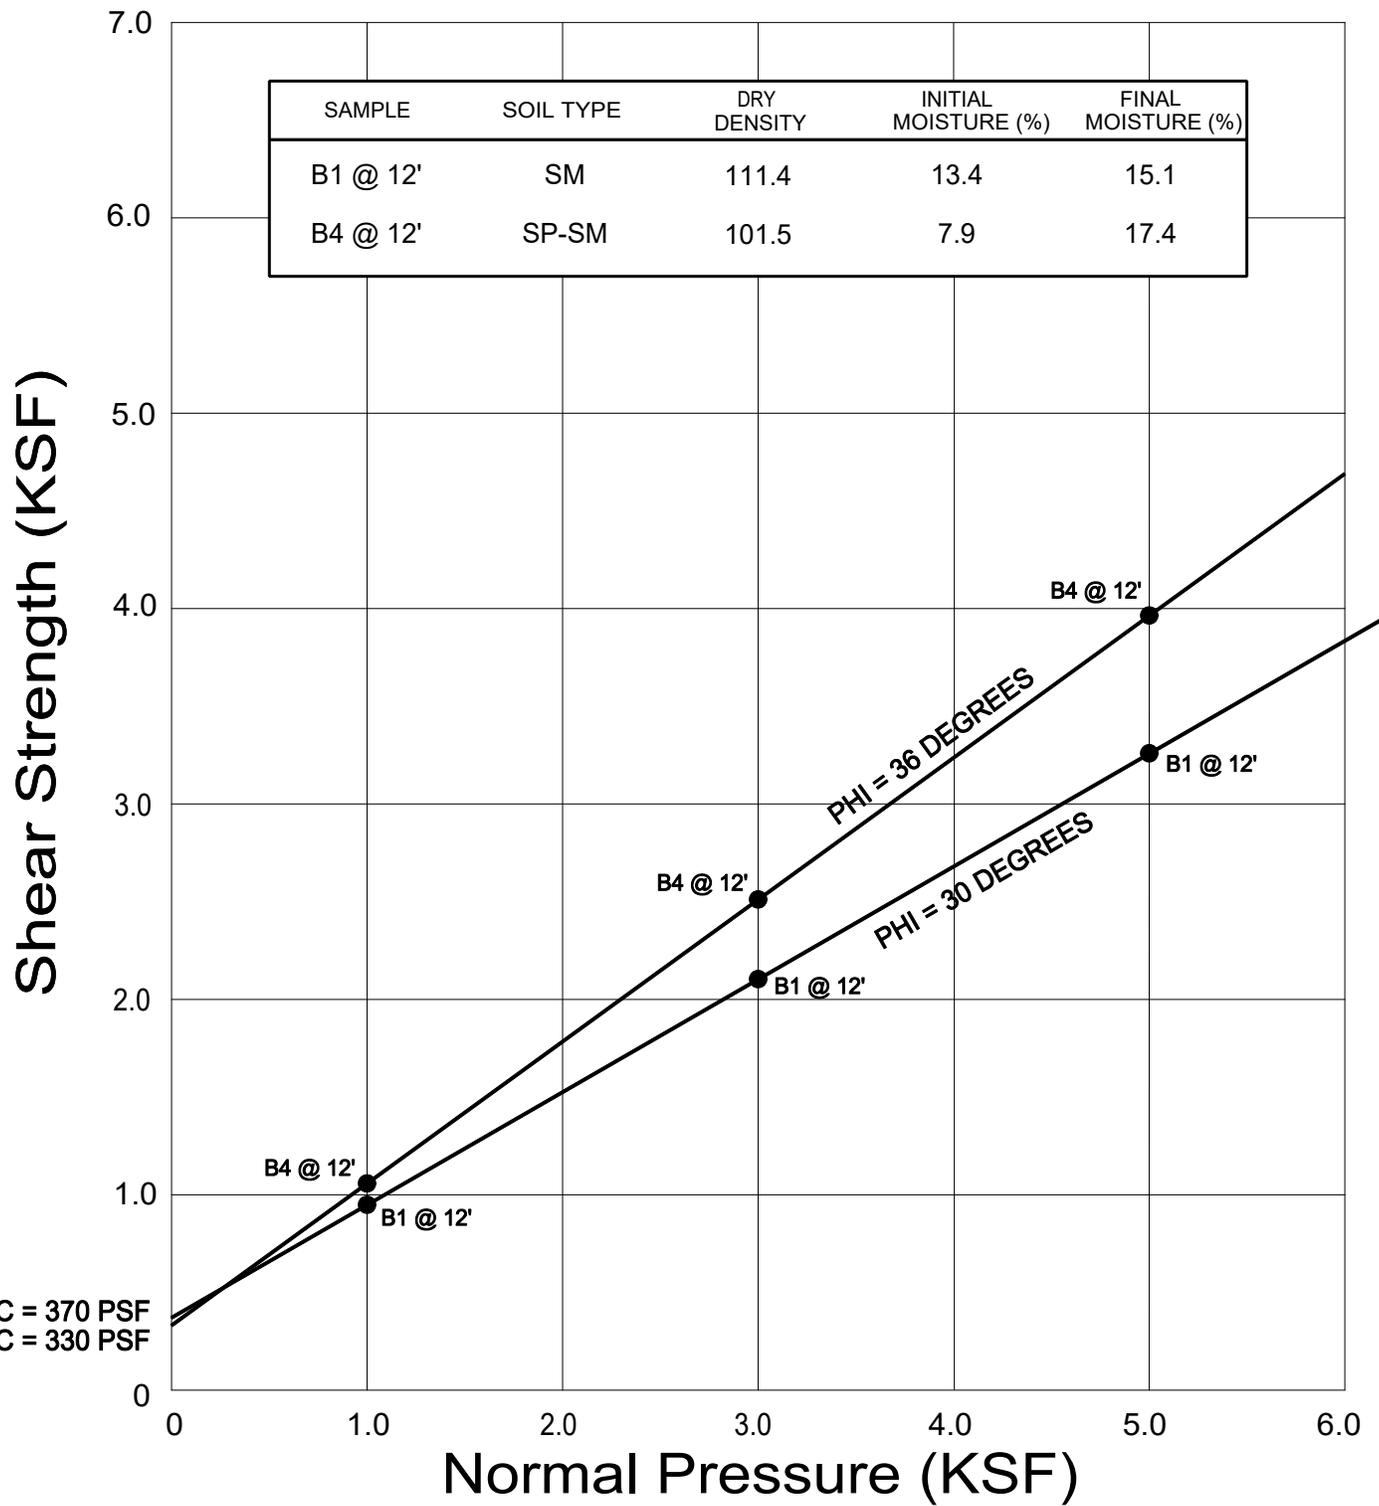

● Direct Shear, Saturated

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT


DIRECT SHEAR TEST RESULTS

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B3

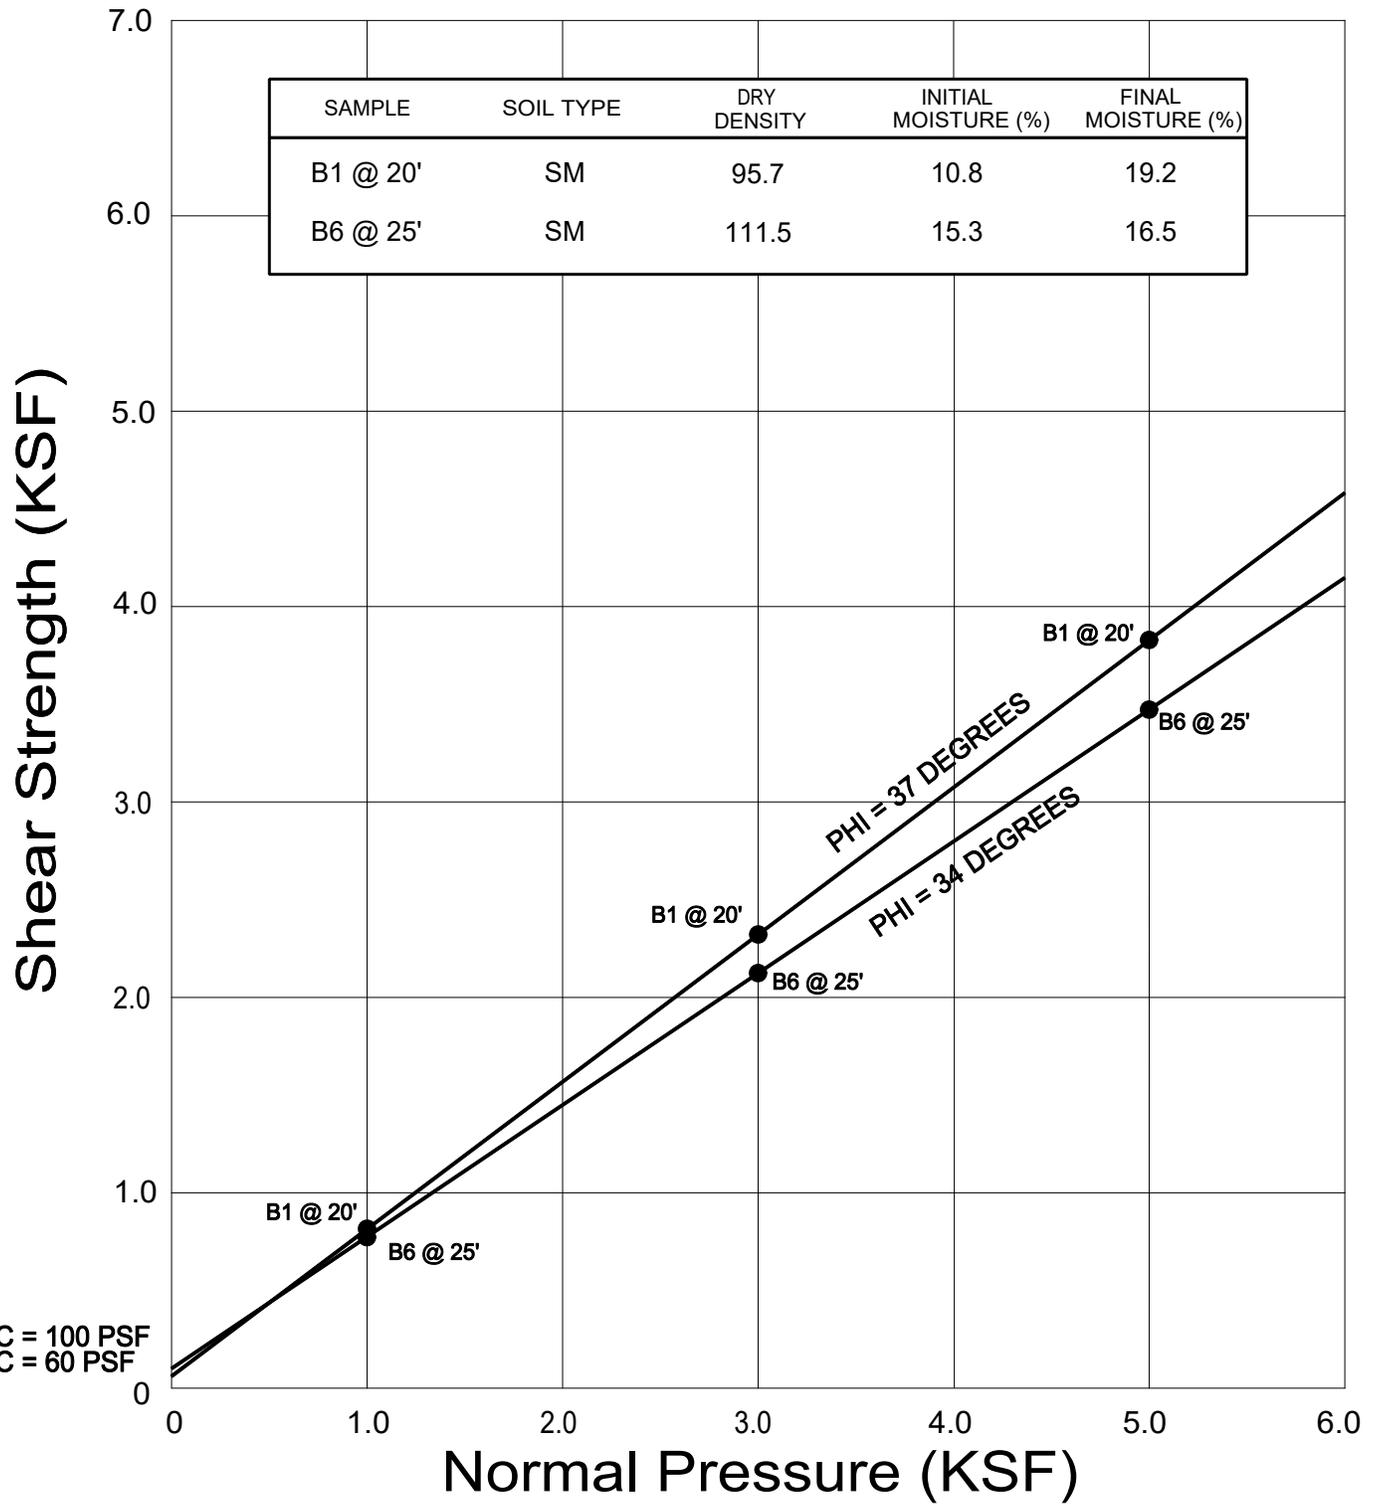

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT

DIRECT SHEAR TEST RESULTS


OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B4

WATER ADDED AT 2 KSF

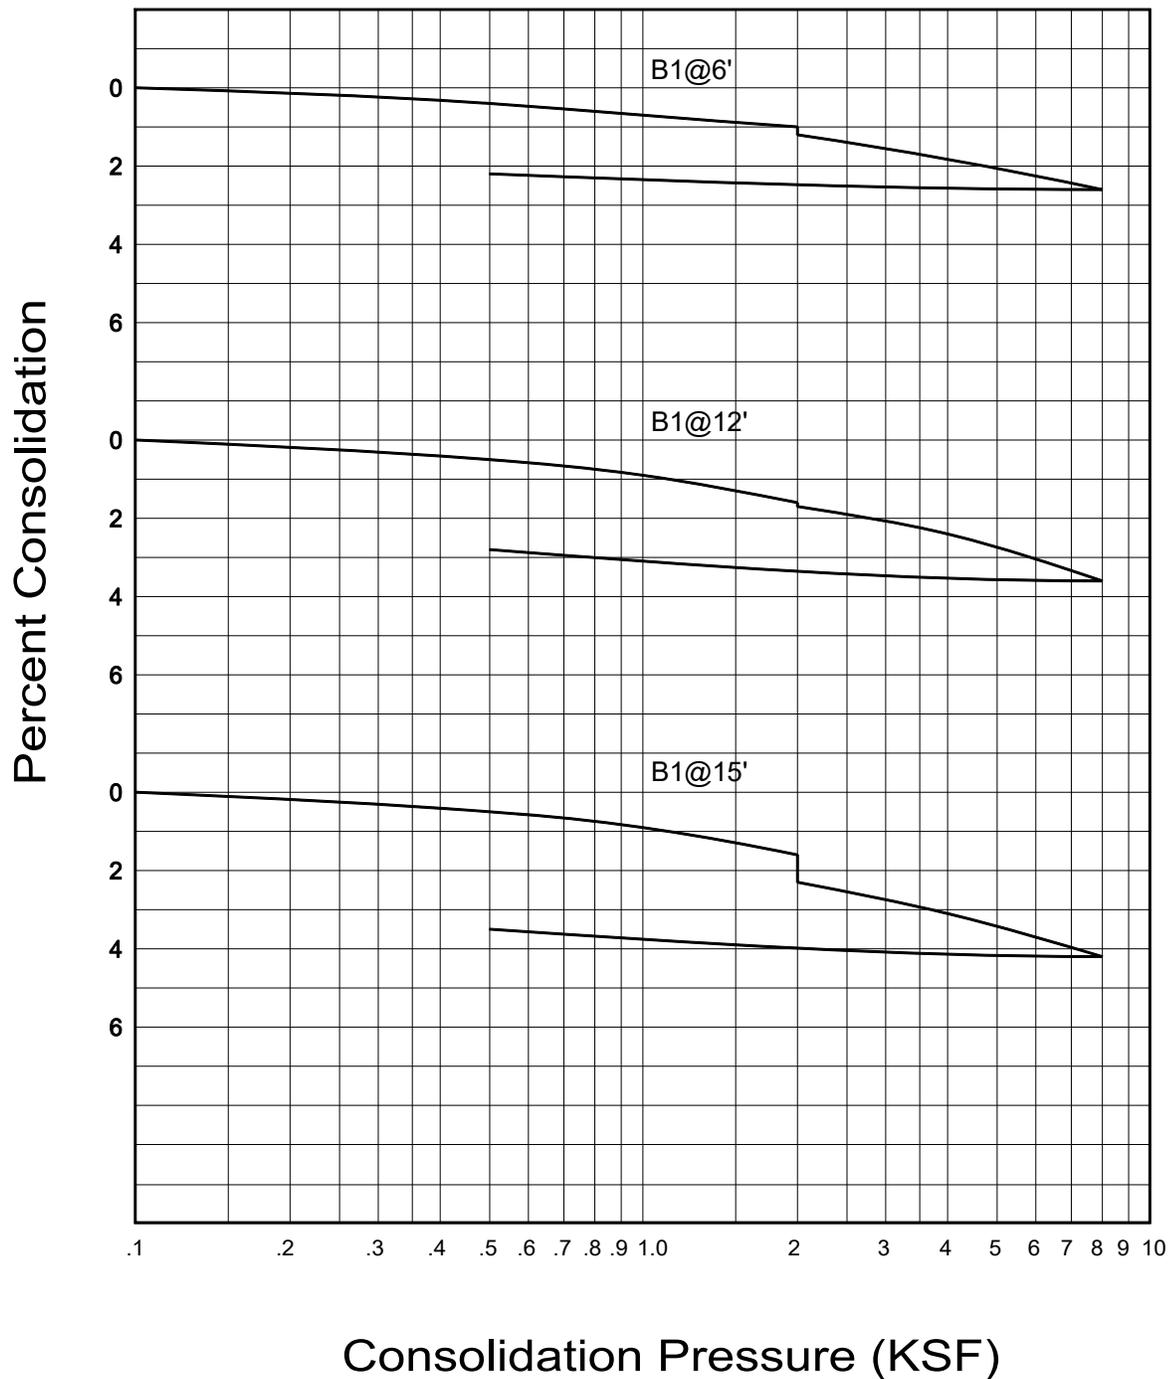

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT

CONSOLIDATION TEST RESULTS


OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B5

WATER ADDED AT 2 KSF

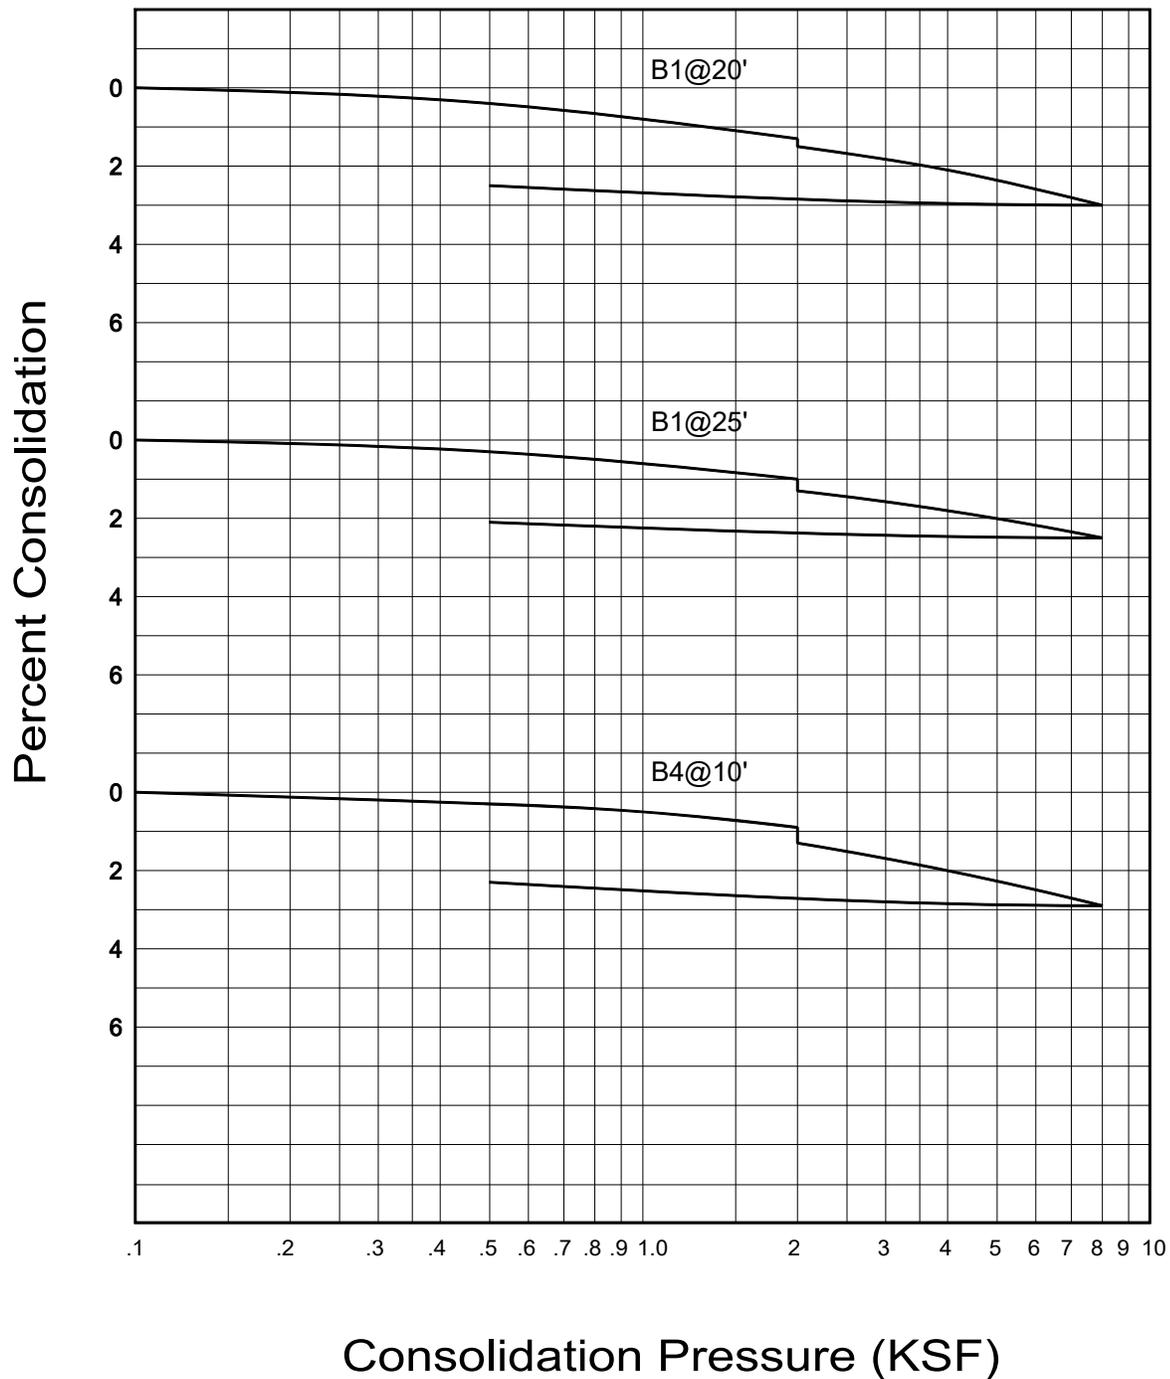

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT

CONSOLIDATION TEST RESULTS


OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B6

WATER ADDED AT 2 KSF

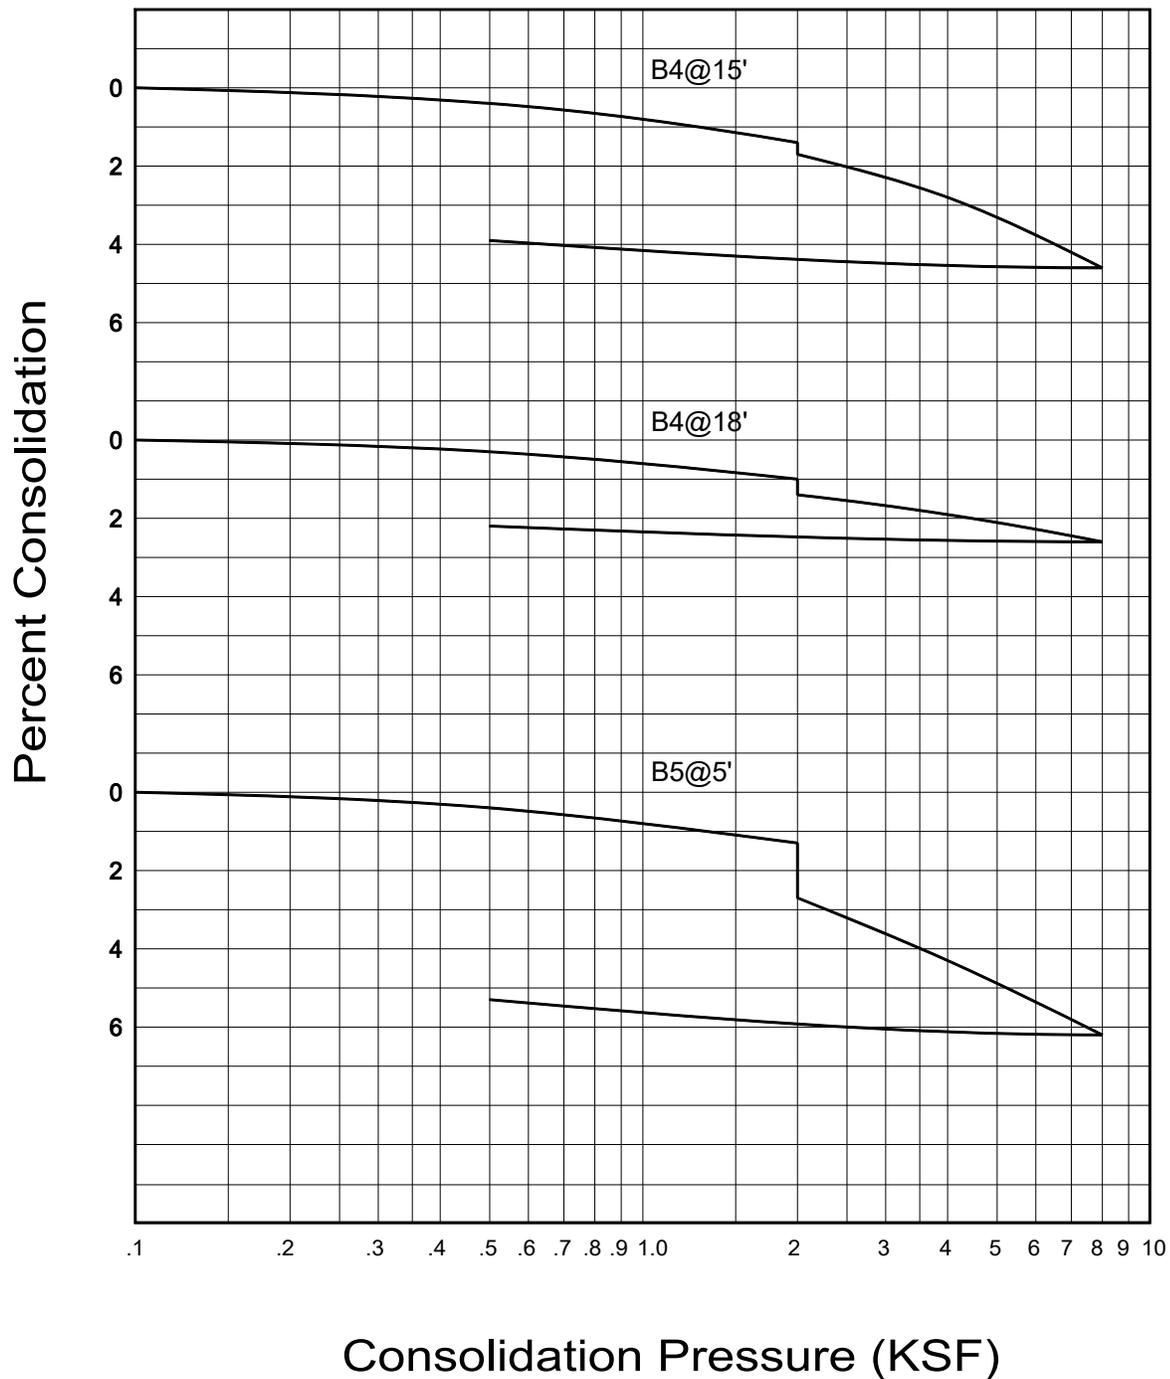

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT

CONSOLIDATION TEST RESULTS


OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B7

WATER ADDED AT 2 KSF

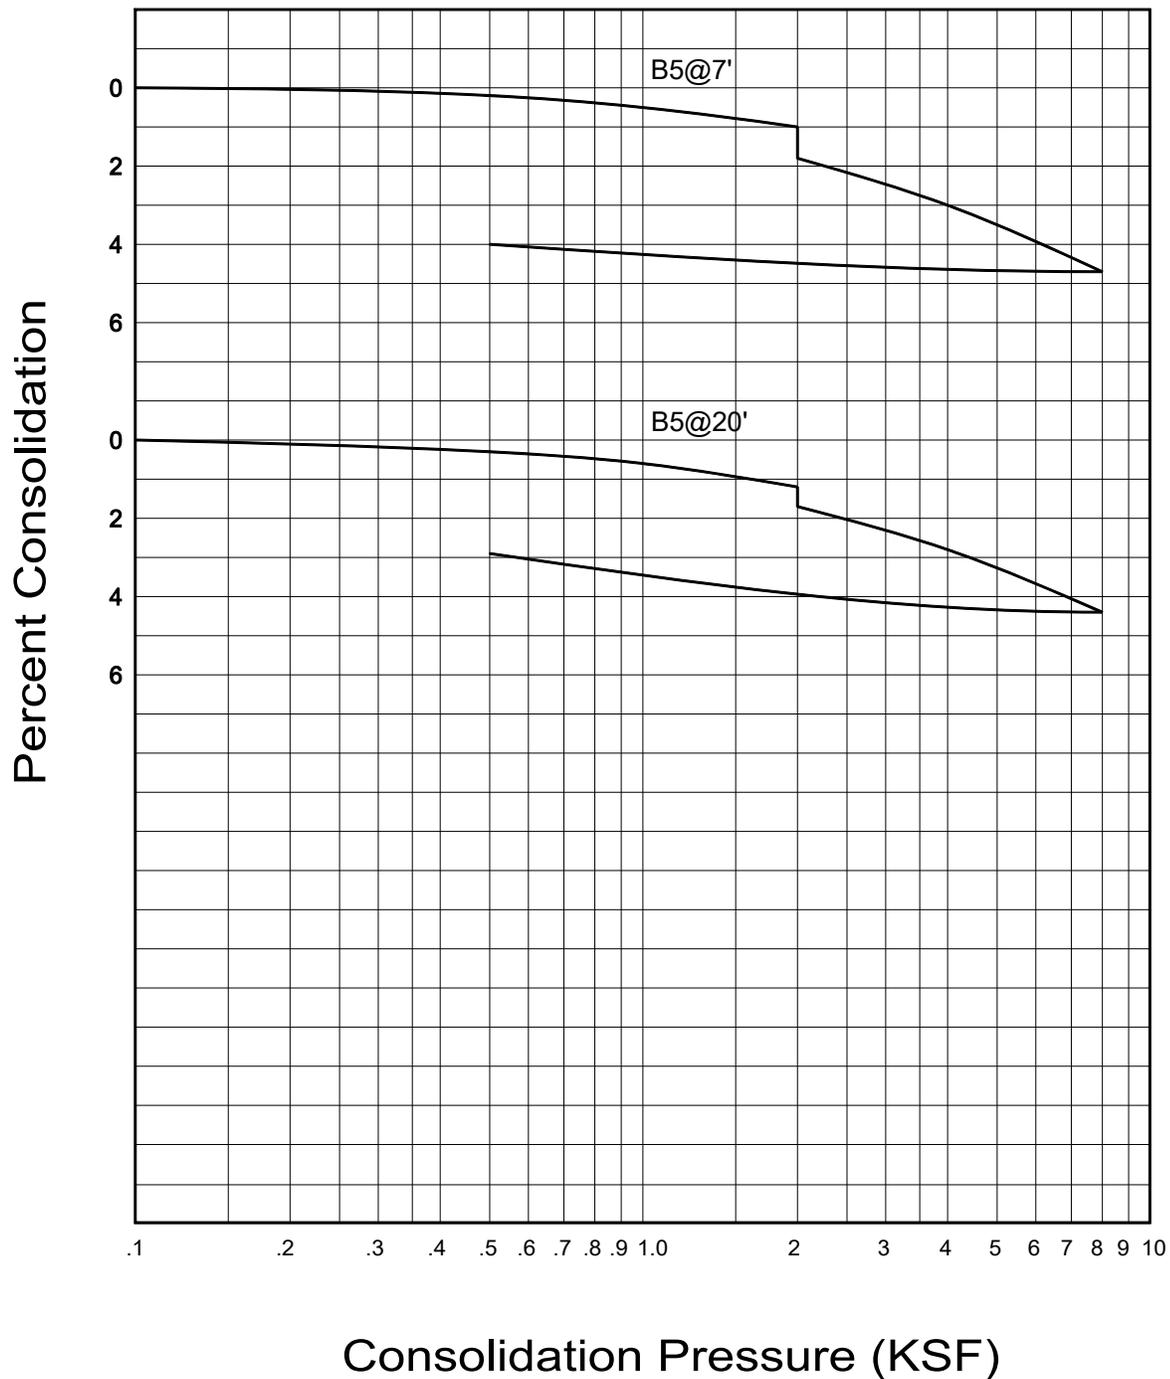

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT

CONSOLIDATION TEST RESULTS

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B8

**SUMMARY OF LABORATORY EXPANSION INDEX TEST RESULTS
ASTM D 4829-11**

Sample No.	Moisture Content (%)		Dry Density (pcf)	Expansion Index	*UBC Classification	**CBC Classification
	Before	After				
B3 @ 0-5'	8.6	12.4	116.1	0	Very Low	Non-Expansive

* Reference: 1997 Uniform Building Code, Table 18-I-B.

** Reference: 2013 California Building Code, Section 1803.5.3

**SUMMARY OF LABORATORY MAXIMUM DENSITY AND
AND OPTIMUM MOISTURE CONTENT TEST RESULTS
ASTM D 1557-12**

Sample No.	Soil Description	Maximum Dry Density (pcf)	Optimum Moisture (%)
B3 @ 0-5'	Light Brown Sand with Silt	128.5	8.8

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT

LABORATORY TEST RESULTS

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B9

**SUMMARY OF LABORATORY POTENTIAL OF
HYDROGEN (pH) AND RESISTIVITY TEST RESULTS
CALIFORNIA TEST NO. 643**

Sample No.	pH	Resistivity (ohm centimeters)
B3 @ 0-5'	8.10	6,000 (Moderately Corrosive)
B6 @ 10-15'	7.75	19,000 (Mildly Corrosive)

**SUMMARY OF LABORATORY CHLORIDE CONTENT TEST RESULTS
EPA NO. 325.3**

Sample No.	Chloride Ion Content (%)
B3 @ 0-5'	0.011
B6 @ 10-15'	0.005

**SUMMARY OF LABORATORY WATER SOLUBLE SULFATE TEST RESULTS
CALIFORNIA TEST NO. 417**

Sample No.	Water Soluble Sulfate (% SO ₄)	Sulfate Exposure*
B3 @ 0-5'	0.000	Negligible
B6 @ 10-15'	0.001	Negligible

* Reference: 2013 California Building Code, Section 1904.3 and ACI 318-11 Section 4.3.

GEOCON
WEST, INC.



ENVIRONMENTAL GEOTECHNICAL MATERIALS
3303 N. SAN FERNANDO BLVD. - SUITE 100 - BURBANK, CA 91504
PHONE (818) 841-8388 - FAX (818) 841-1704

DRAFTED BY: PZ

CHECKED BY: JMT

CORROSIVITY TEST RESULTS

OLD TOWN-MAIN, LLC
C/O SERRANO DEVELOPMENT GROUP, INC
MAIN STREET & 9TH STREET
SANTA CLARITA, CALIFORNIA

NOV. 10, 2015

PROJECT NO. A9332-06-01

FIG. B10